
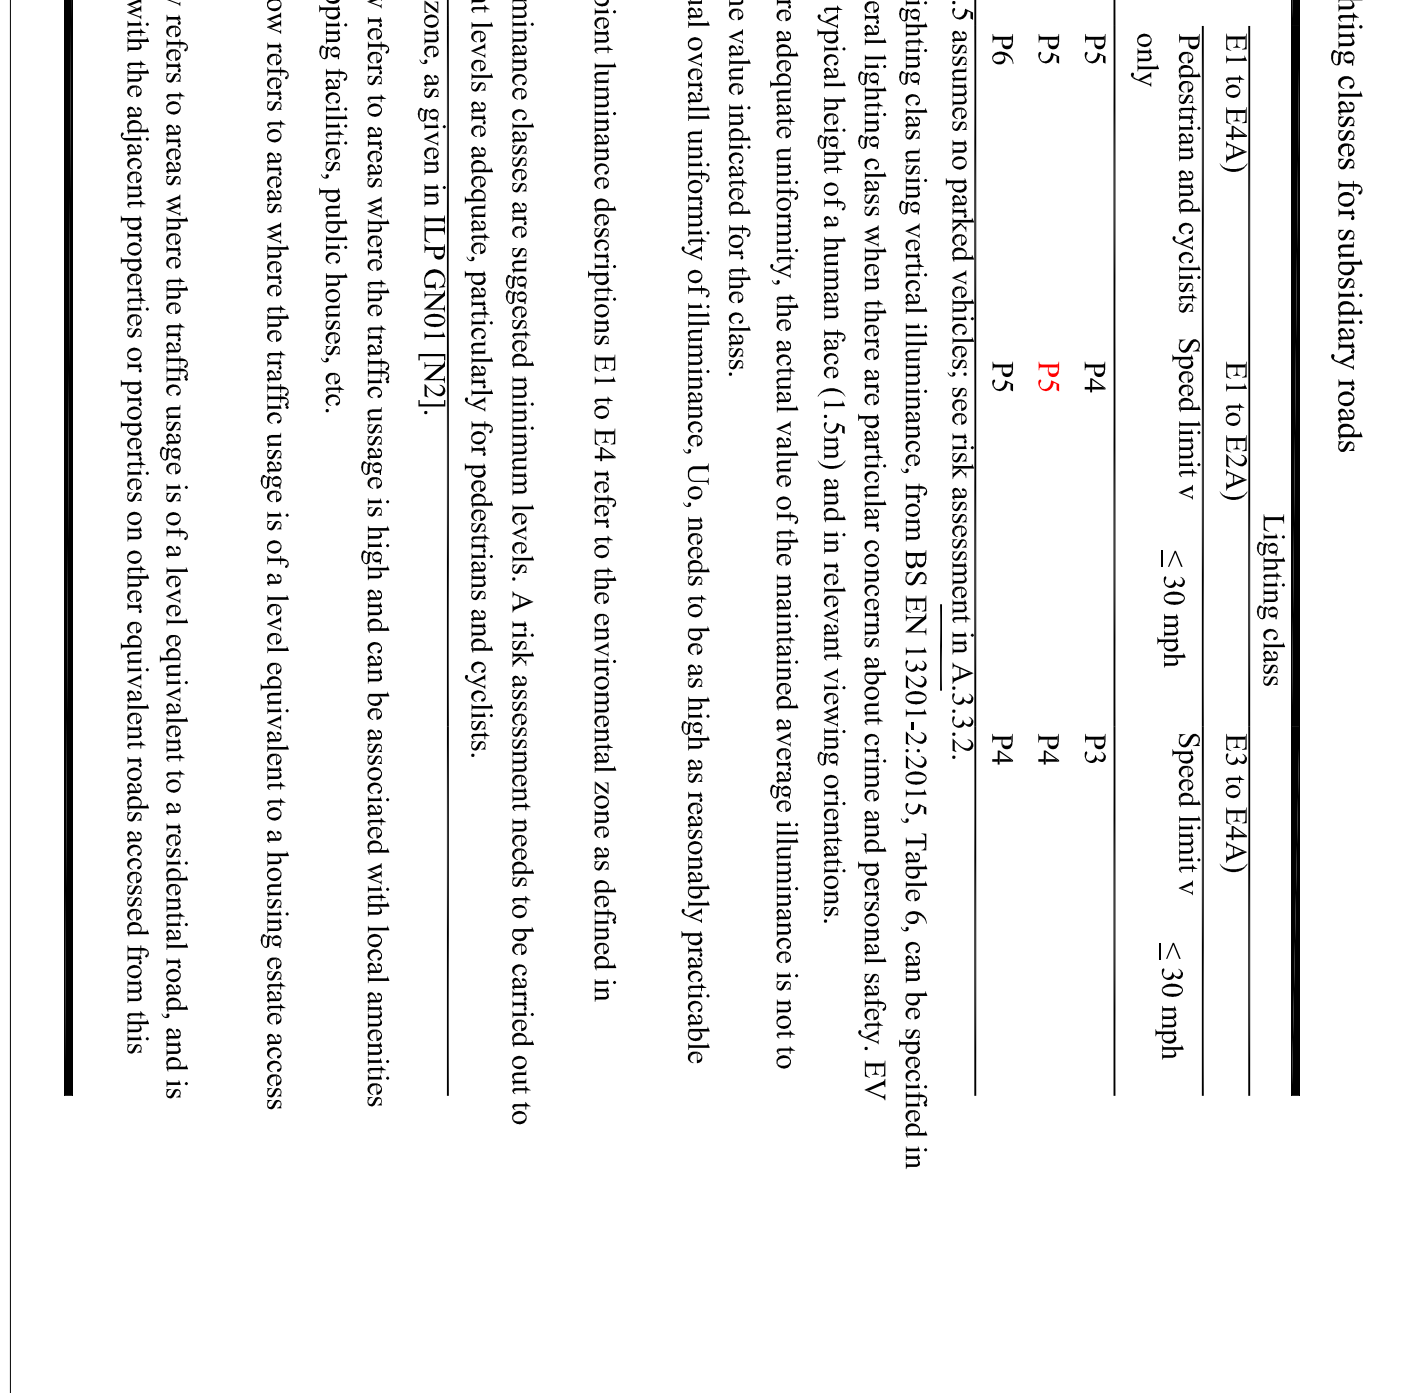


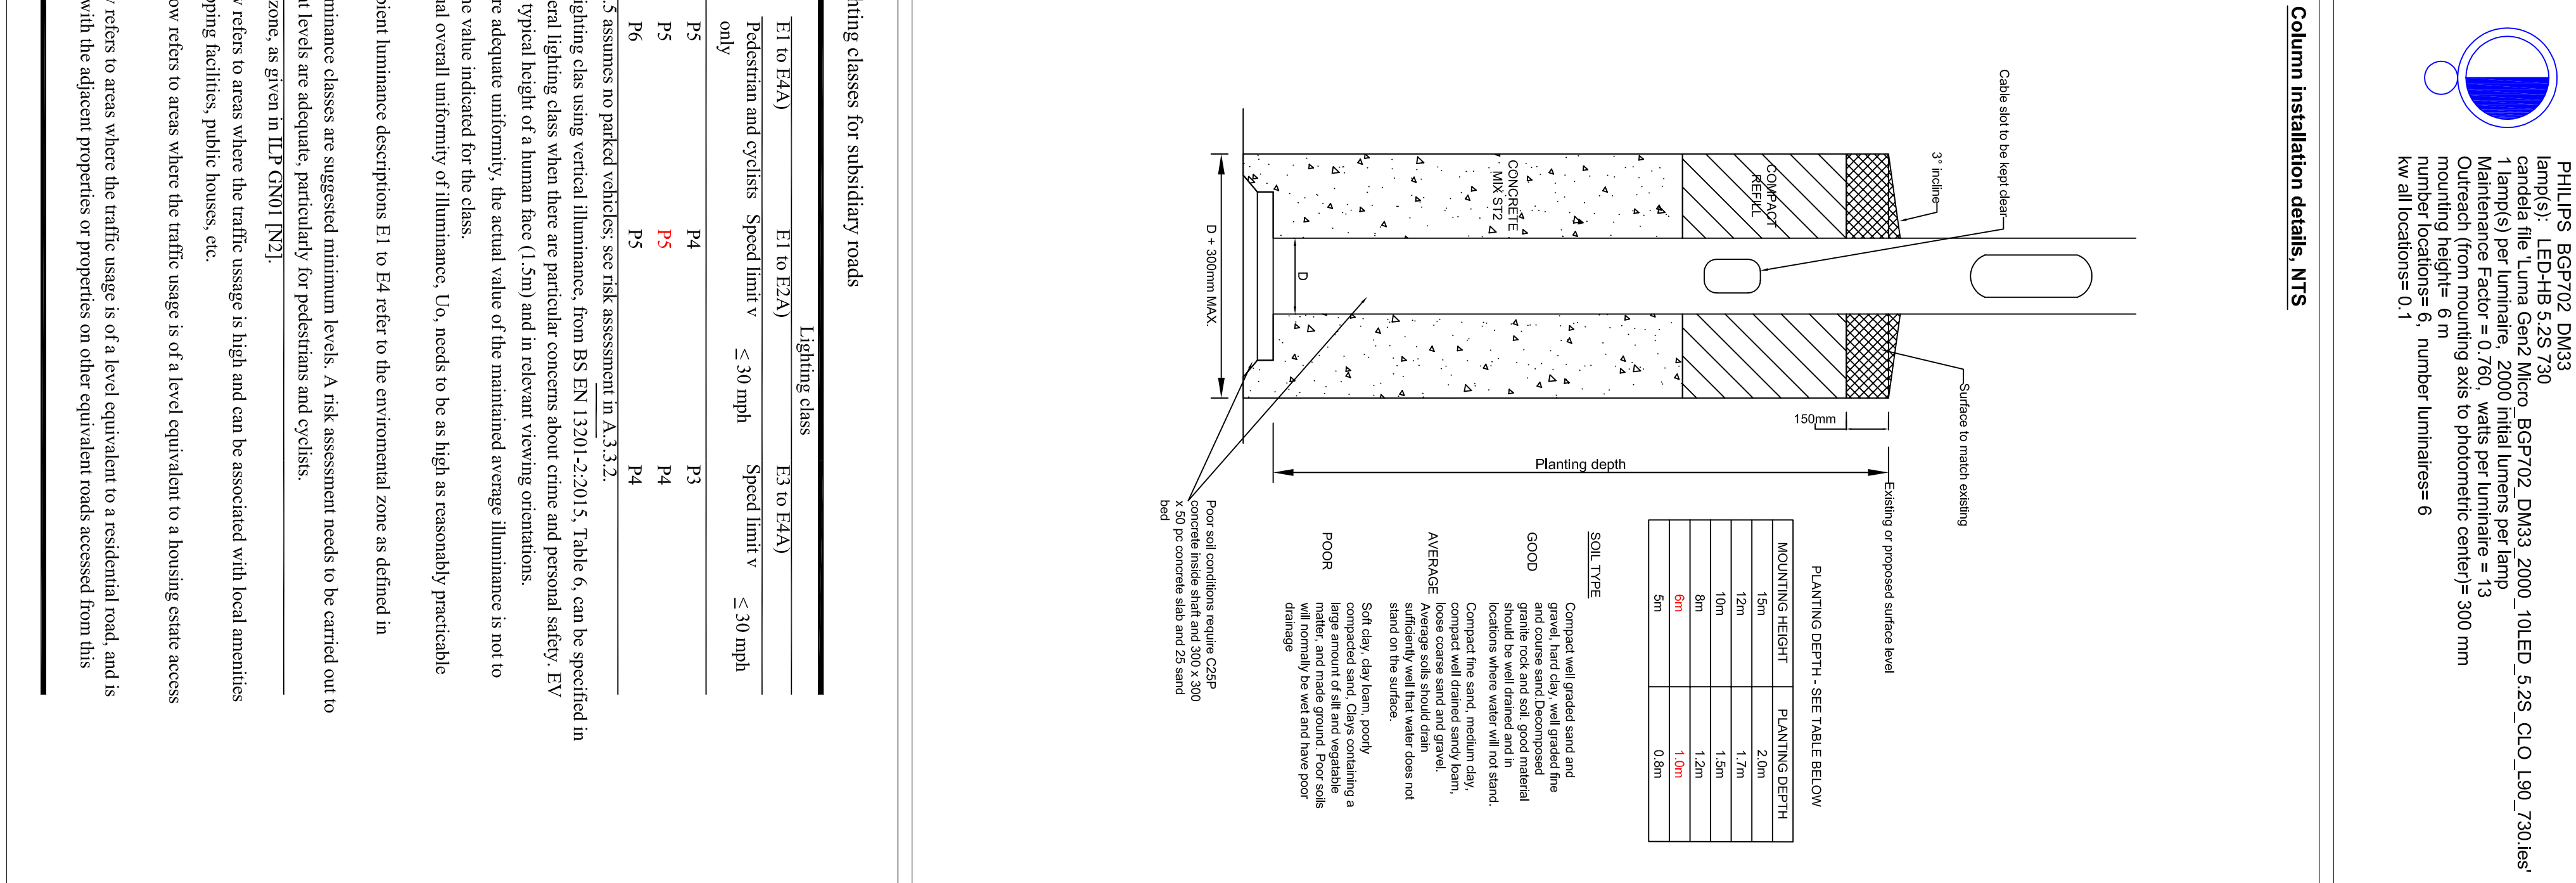

PHILIPS BGP702 DM33 lamp(s) = LEH-BH-5,2S 730 candle(s) the Lumina Gen2 Micro BGP702 DM33, 2000 '10LED 5.2S CLO 190 730ies' 1 lamp(s) per luminaria, 2000 initial lumens per lamp
 Mounting height= 6 m
 Overcast from mounting axis to photometric center)= 300 mm
 mounting height= 6 m
 number locations= 6, number luminaires= 6
 kw all locations= 0.1

(All of the above is manufacturer's country code specification)

[illegible]

Proposed
Column (To Be Installed):
Manufacturer: Mallabbe
Material: Steel

Height: 61mm
Root protection: Galvanised
Proposed
Lantern To be installed:
Manufacturer: Philips
Model: Micro Luma
Tilt: 0°
Photometry file: Luma Gen2 Micro
_BGP702_DM35_2000_10LED_5.2S
_CL01_190_730.lux*

Wattage: 13W
Driver: DALI enabled driver, Philips
City/Town: CMS mode

(All of the above to Manchester County Court specification)

Proposed column scheme number

A01
P
EB-N

A01 = Column Number
P = Proposed
EB-N = Proposed New DNO/IDNO code

NOTES

1. All equipment to be supplied by the contractor must be in accordance with the relevant British Standards and the relevant European Standards.
2. Prior to excavation works the installation contractor must be aware of any overhead obstructions. Advice should be sought from the developer's engineering representative.
3. The installation contractor must be aware of any overhead obstructions. Advice should be sought from the developer's engineering representative.
4. For column installation details refer to the Development Standard Specification for Street Lighting Works approved by Manchester City Council.
5. All columns provided for adoption by Manchester City Council shall be supplied by the DNO.
6. Joint technical approval has been obtained from the relevant design authority. It should be understood that the drawings submitted are preliminary and NOT for construction.
7. Design maintenance factor utilised is 0.75 as provided by Manchester City for the Phillips HPLC L275 as per the specification of 1481 provided by Manchester CC for the Phillips Luminaire.

REV	DESCRIPTION	DATE	PREPARED BY
	DRAWING NO: 23650-D-01		REV: -
DRAWING STATUS:			
CLIENT: Jenkins Design			
PROJECT: Station Works, Manchester Section 38			
TITLE: Proposed Lighting and Installation Design Layout			
SCALE: As indicated	DESIGNED BY: TL 26/09/22		
SHEET NO: Sheet 1 of 1	APPROVED BY: PDL 04/10/22		



Harttron

CONSULTATION, DESIGN & INSTALLATION

E. info@harttron.com      

01625 850865 F. 01625 850856

© Harttron 2022