


BS 6700 SIZING:			
ITEM	QTY	DU	TOTAL
PREP SINK	5No	3	15
WHB	2No	1.5	3
			18

18 DU (DEMAND UNIT) = 0.41L/S 24.6L/M

DOMESTIC HOT WATER
2No. ALPHA 33 E-TEC GAS BOILERS

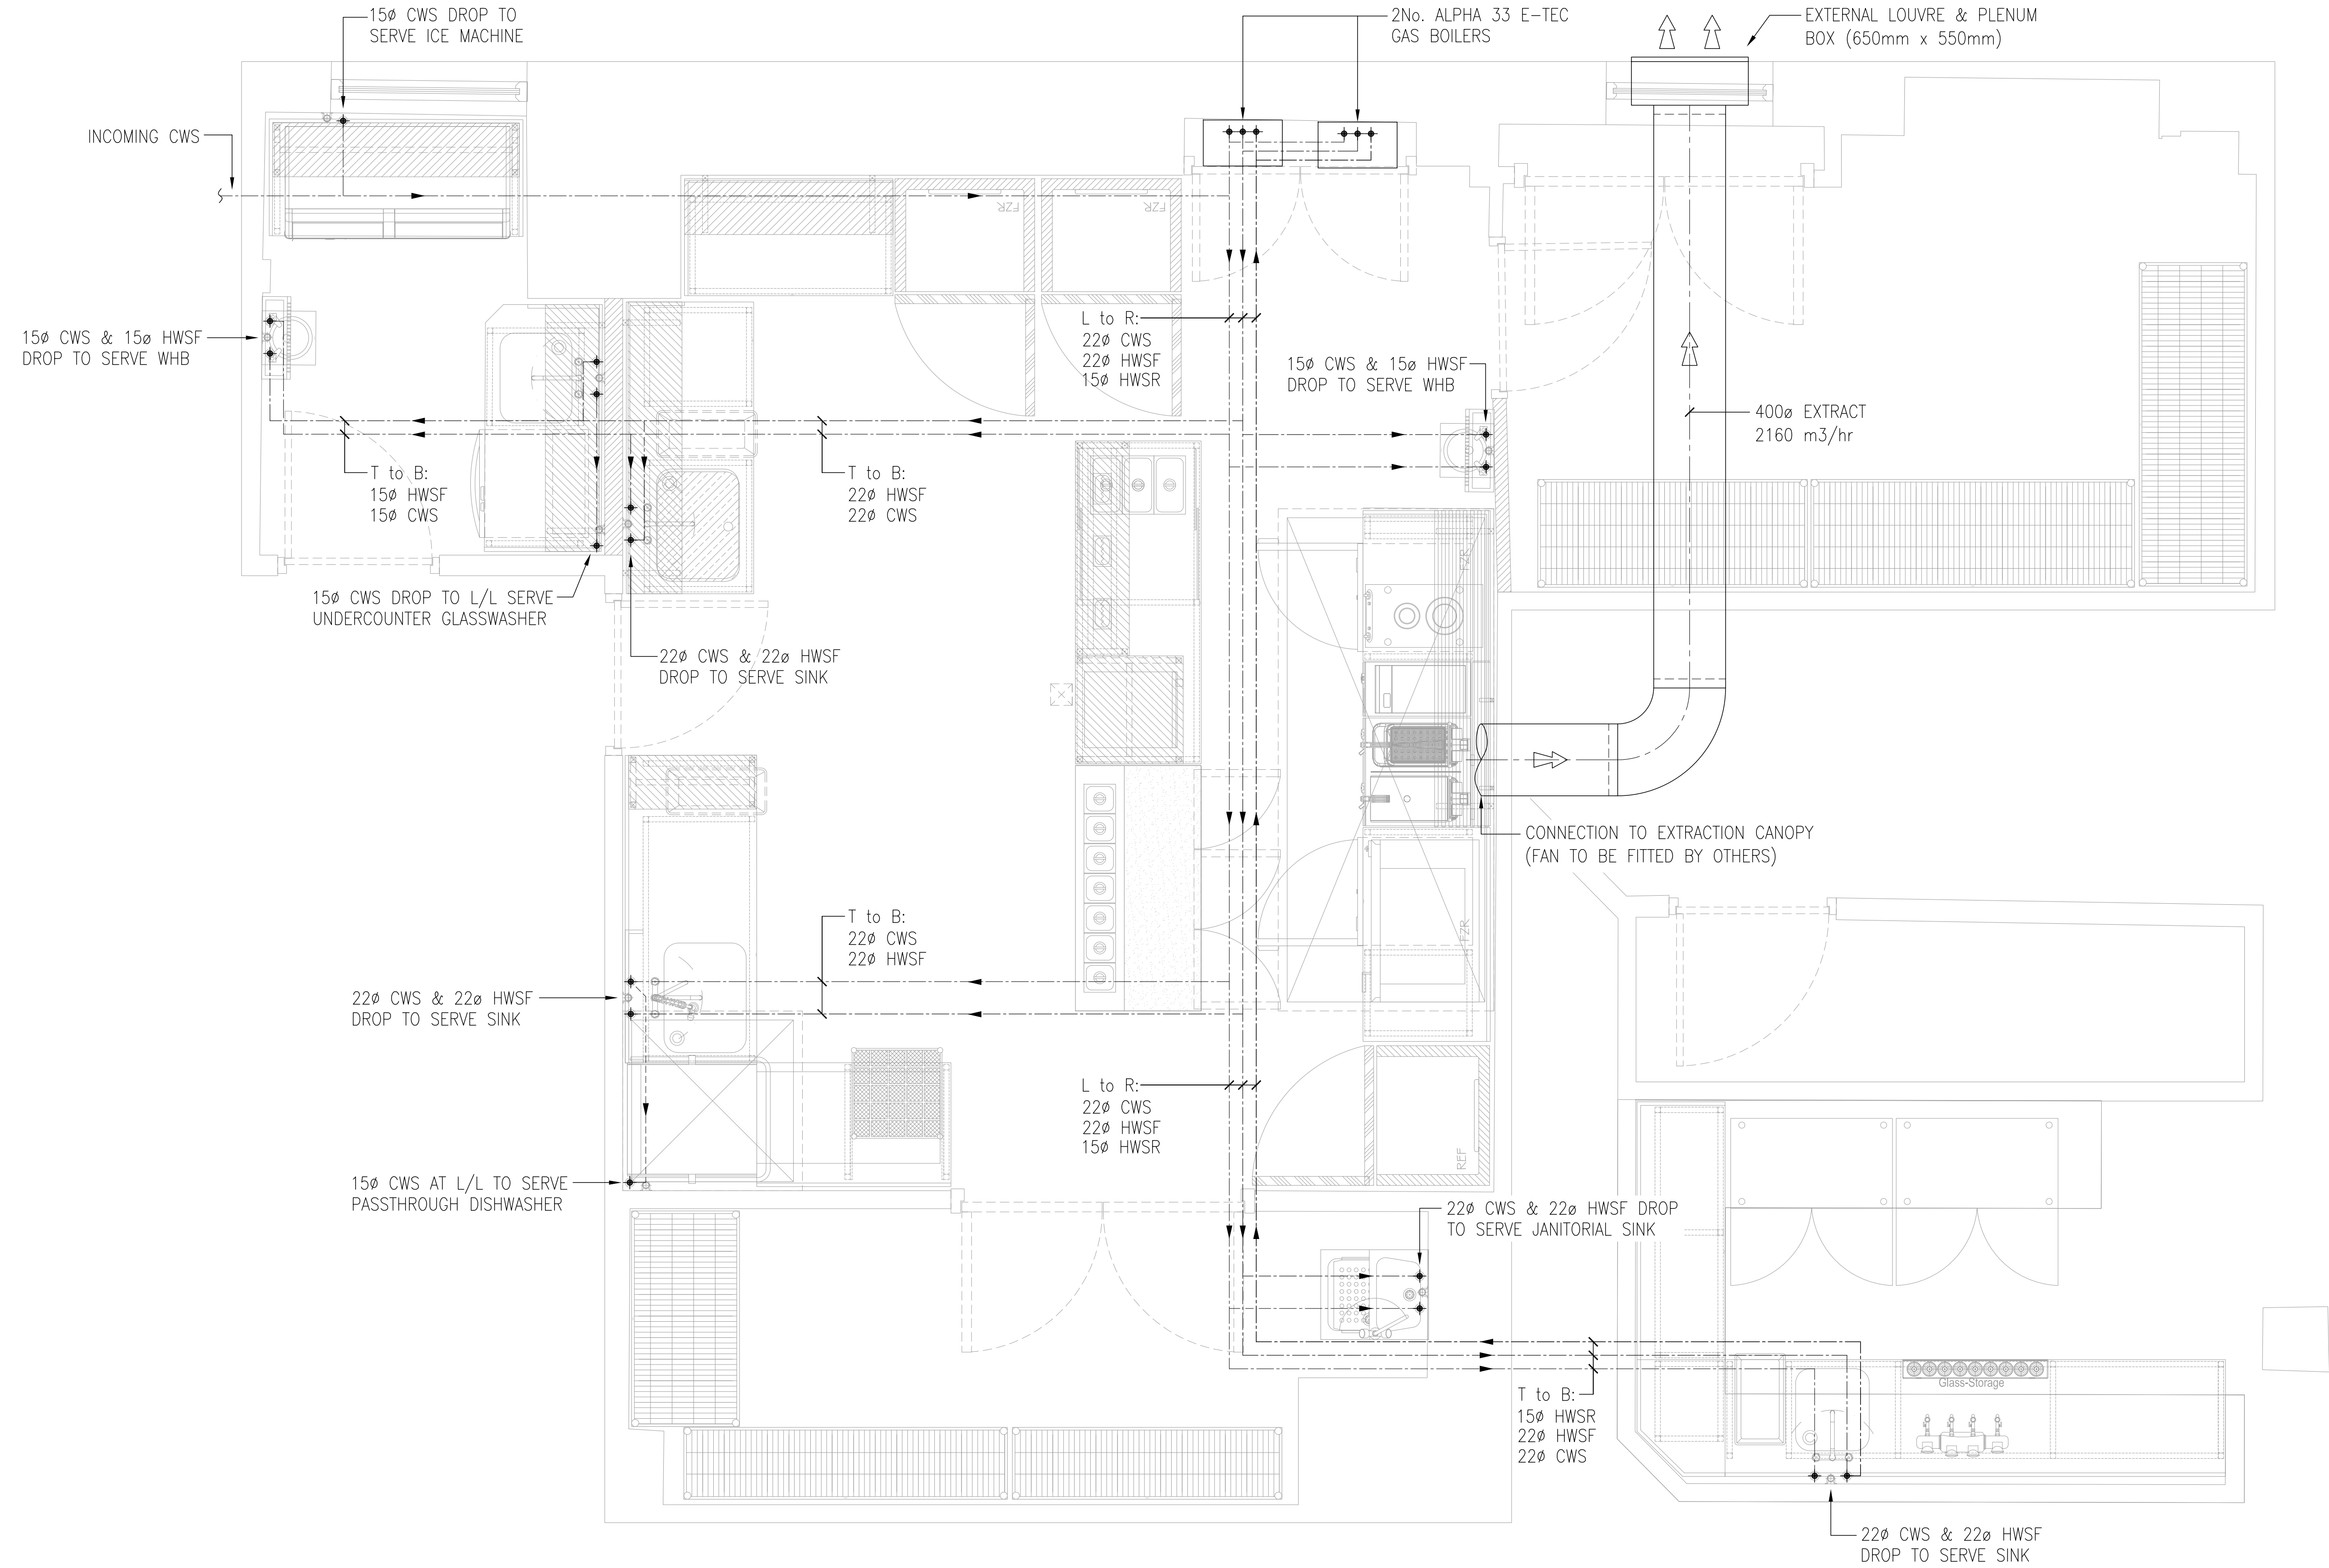

P01	ISSUED FOR APPROVAL	01/08/22
REV	DESCRIPTION	DATE



SUITE 5, MAYDEN HOUSE
LONG BENNINGTON BUSINESS PARK
MAIN ROAD, LONG BENNINGTON
NOTTINGHAMSHIRE
NG23 5DJ

Project:
HUKD, LINK HOUSE
35 WALMERSLEY ROAD, BURY

Description:
KITCHEN PLAN
MECHANICAL SERVICES LAYOUT

Dwg. no.	Scale:
HUKD-M-03	1:20 @ A1
	Date: 01-08-22