
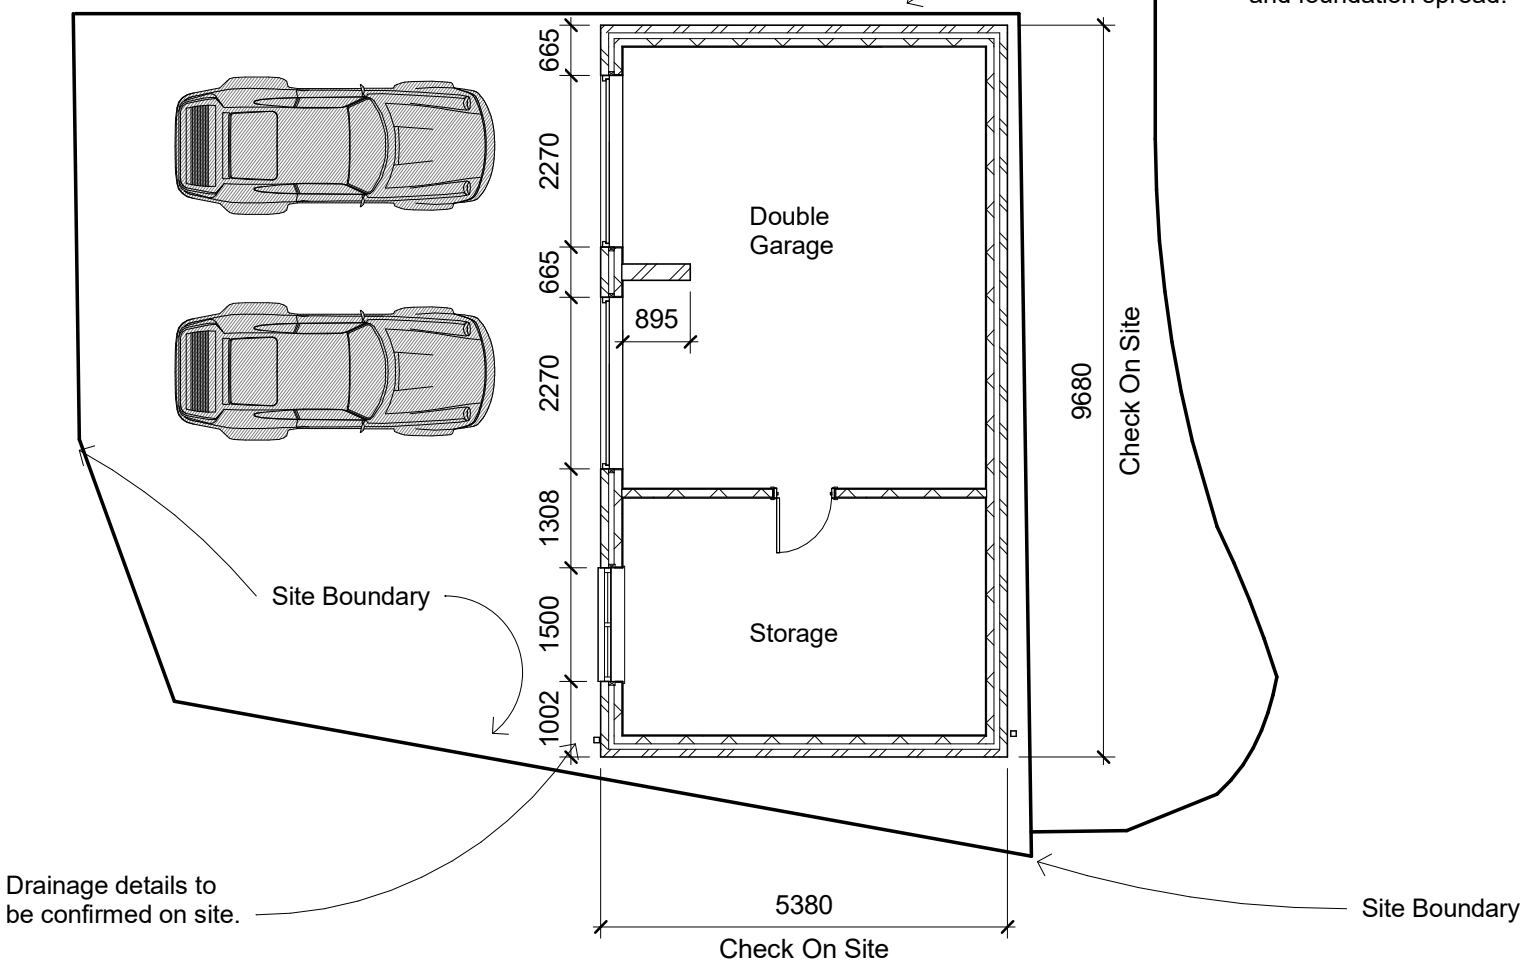


UNDERGROUND FOUL DRAINAGE Underground drainage to consist of 100mm diameter UPVC proprietary pipe work to give a 1:40 fall. Surround pipes in 100mm pea shingle. Provide 600mm suitable cover (900mm under drives). Shallow pipes to be covered with 100mm reinforced concrete slab over compressible material. Provide rodding access at all changes of direction and junctions. All below ground drainage to comply with BS7158 and BS80 1

WALL TIES All walls constructed using stainless steel vertical twist type retaining wall ties built in at 750mm ctrs horizontally, 450mm vertically and 225 mm ctrs at reveals and corners in staggered rows. Wall ties to be suitable for cavity width and in accordance with BS 5268-6.1: 1996 and BS EN 845-1: 2003


CAVITIES Provide cavity trays over openings. All cavities to be closed at eaves and around openings using Thermabate or similar non combustible insulated cavity closers. Provide vertical DPCs around openings and abutments. All cavity trays must have 150mm upstands and suitable cavity weep holes (min 2) at max 900mm centres.

DPC Provide horizontal strip polymer (hyload) damp proof course to both internal and external skins minimum 150mm above external ground level.New DPC to be made continuous with existing DPC's and with floor DPM.Vertical DPC to be installed at all reveals where cavity is closed.

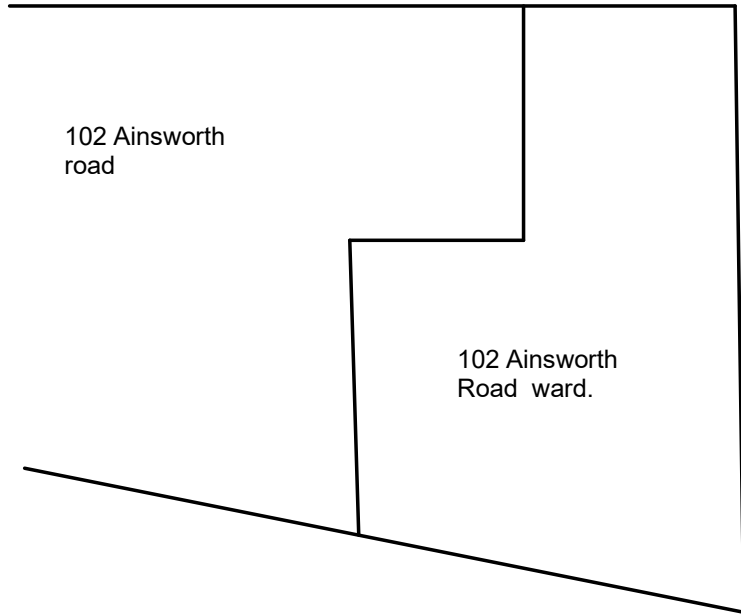

DRAINAGE Full drainage system on site is to be identified on site at the time Of excavation .If the property is served by a combination system Or separate system, that system must be maintained during and after construction. All re routing and additional drainage layouts are to be confirmed and approved by the building inspector prior to the laying of the drains.All drain bends. Any drainage re-routing as a result of this application is to be agreed in advance of construction and in accordance with the building inspectors and utilities requirements. Drain inspection Chambers less than 930 mm are to be polypropylene with a metal Frame and cover. Drainage runs indicated on drawings submitted are assumed based on what is visible at the time of survey and should not be relied upon as being a complete drawing survey.Prior to any excavation works the contractor must determine the exact positions of all drainage runs including pipe size,depths,rodding access points and inspection positions. Depending upon this information delays may occur in the construction process due to the need to consult united utilities or to commission CCTV survey.The contractor is advised of their responsibilities to maintain adequate temporary supports for all excavation works. All drainage to be to satisfaction of LA building inspector

All Measurements to be checked on site
All drainage to satisfaction of LA Bldg Insp on site



1 gl
1 : 100

			Planning Building Control Structural Calculations Project Management	PROJECT Proposed Garage To Rear Of 102 Ainsworth Road,Radcliffe,Manchester,M26 4ED.		CLIENT Alpha Properties	
				SHEET Proposed Layout	Date 17/11/2022	Project number NDH/LR/10/22	Scale (@ A3) 1 : 100
						DRAWING NUMBER	REV
						2 Of 4	