



new Eurenor solar panel array as per specification sheet to be fixed to existing slate roof with solar limpets. Limpet to be fixed by drilling precisely through an existing slate. A bonding and sealing adhesive with a 25 year guarantee is used to bond the solar limpet to the slate and two screws are used to fix the limpet directly to the timber rafter or roof joists of the roof structure. No slates are removed and there is no requirement for slate hooks to support and replaced slates. Infrastructure cables are to run along the roof at gutter level and enter the building via the external wall on the roof terrace adjacent to other service penetrations with a cable drip loop and cable cover. The inverter is to be located within the existing second floor plant room and will be wall mounted adjacent to existing electrical distribution boards and ventilation control panels.

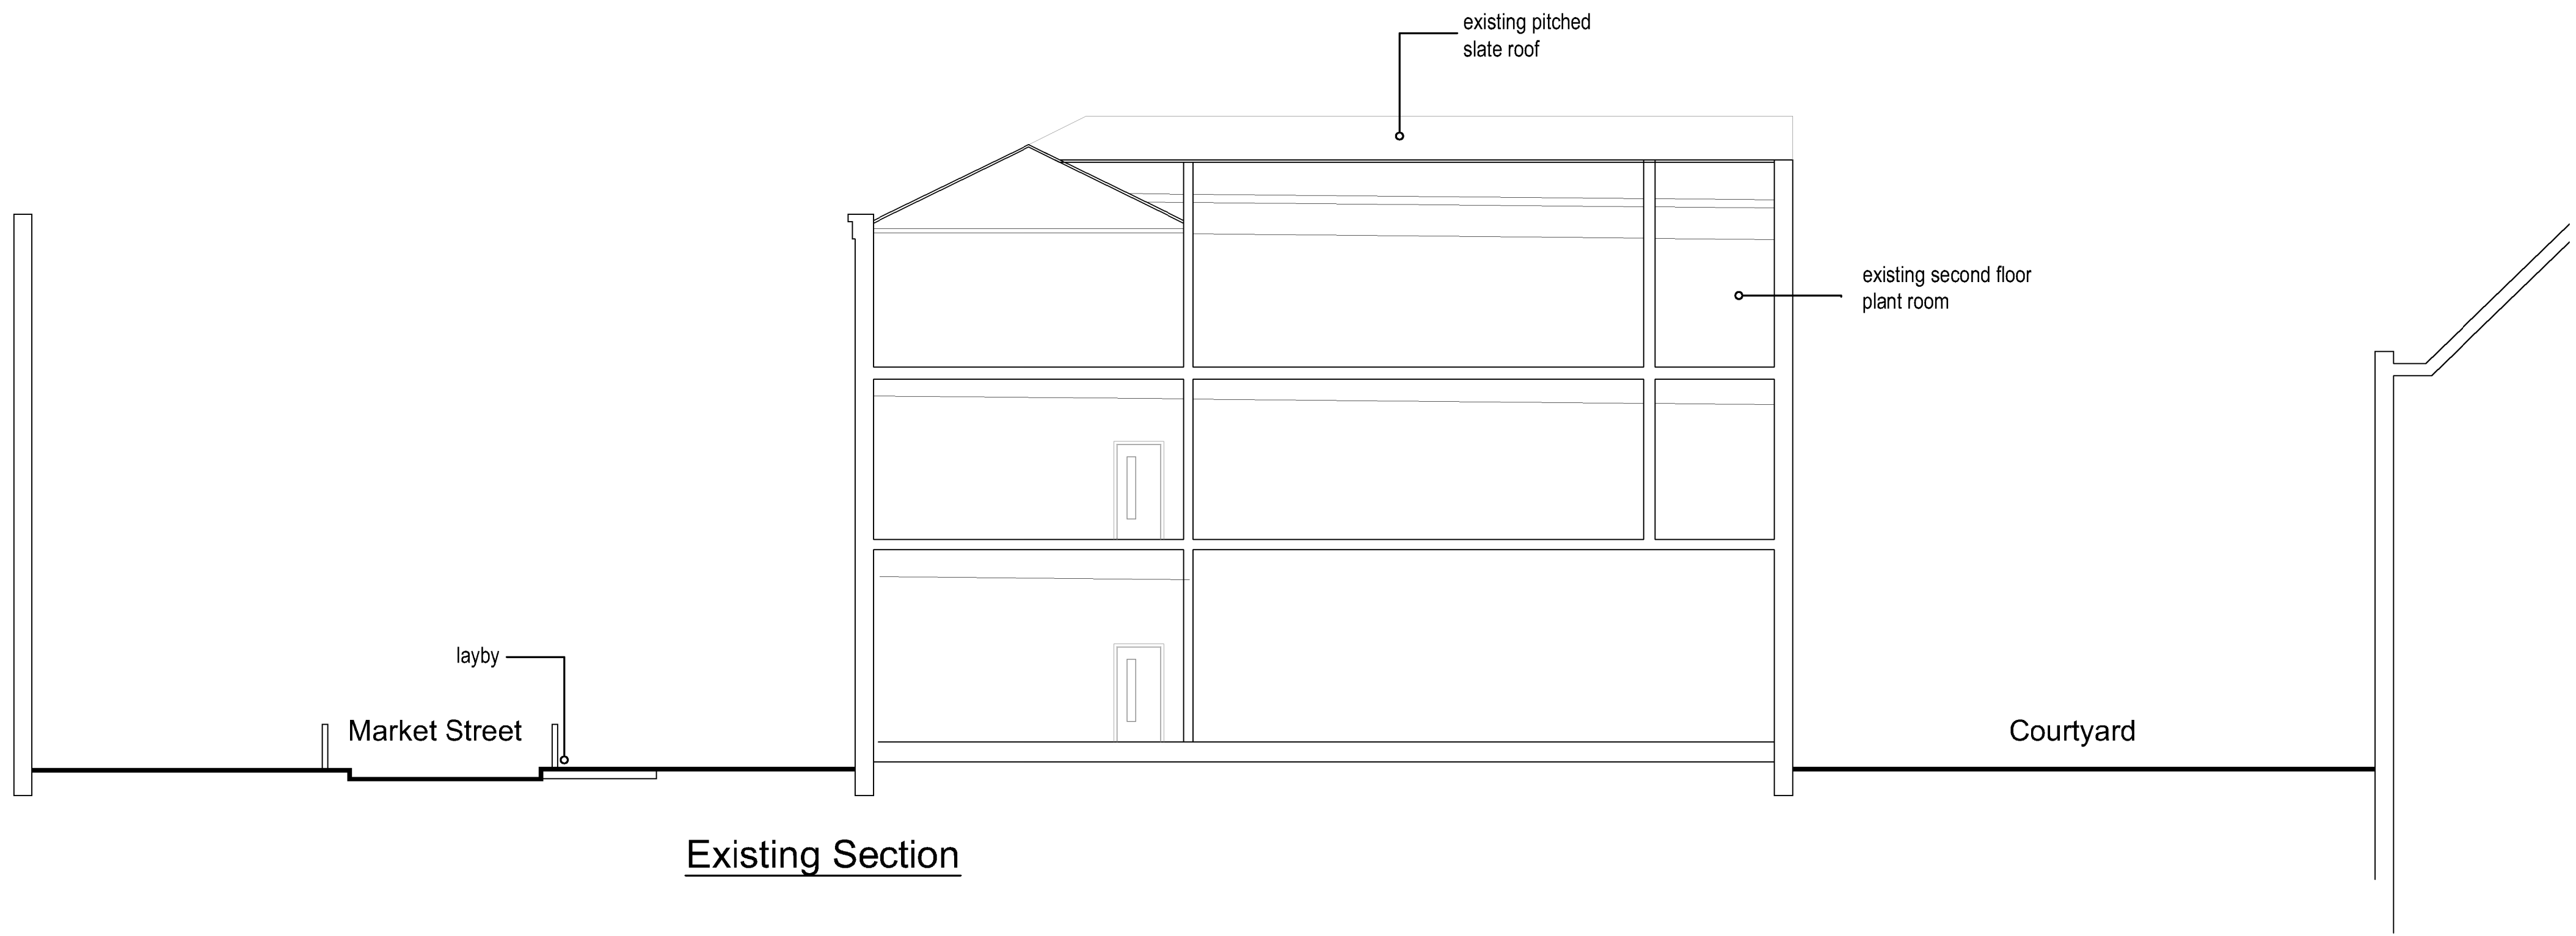

Existing Section

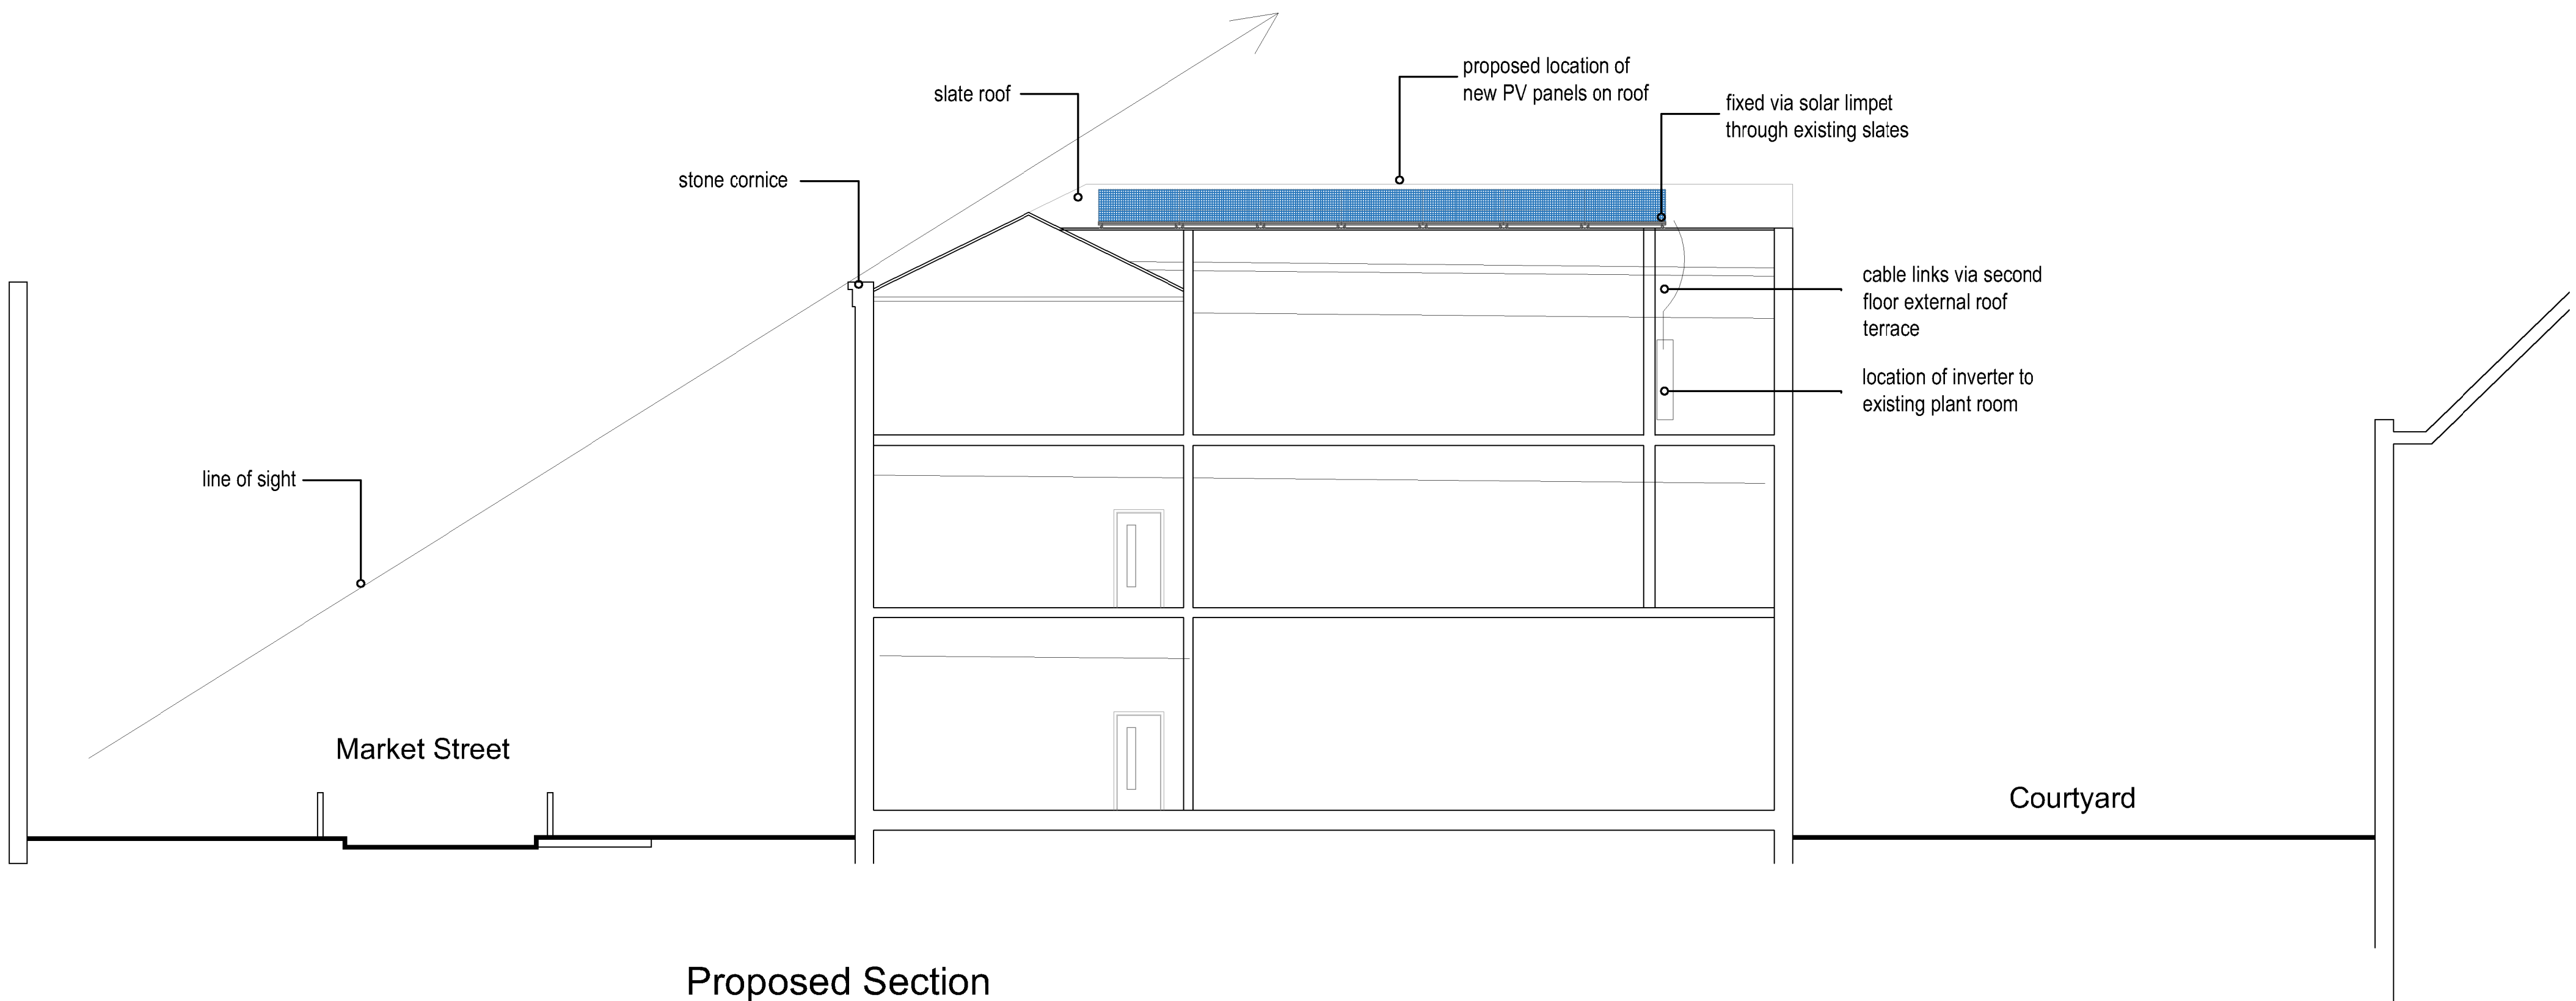

Proposed Section

|             |                                      |          |       |         |
|-------------|--------------------------------------|----------|-------|---------|
| P2          | PV panel specification amended       | 15.02.22 | MW    | MW      |
| P1          | First Issue. Issued for Information. | 14.02.22 | PC    | MW      |
| PRELIMINARY |                                      |          |       |         |
| Revision    | Description                          | Date     | Drawn | Checked |

Halliday Meecham Architects Limited

111 Piccadilly Manchester M1 2HY  
+44 (0)161 661 5566

4 Devonshire Street London W1W 5DT  
+44 (0)203 440 5175

hma@hallidaymeecham.com  
www.hallidaymeecham.com



|                          |                                |        |             |          |
|--------------------------|--------------------------------|--------|-------------|----------|
| Client:                  | Warden Construction            |        |             |          |
| Project:                 | Bury PSD Scheme                |        |             |          |
| Phase/ Location:         | Derby Hall Bury Met            |        |             |          |
| Drawing:                 | General Arrangement Section BB |        |             |          |
| Scale @ A1               | Scale @ A3                     | Date:  | Drawn:      | Checked: |
| 1:100                    | 1:100                          | FEB 22 | PC          | MW       |
| Job No.                  |                                |        | Drawing No. |          |
| 5449                     |                                |        | 0005        |          |
| Drawing Ref.             |                                |        |             | Revision |
| 5449-HMA-TM-00-DR-A-0005 |                                |        |             | P2       |