


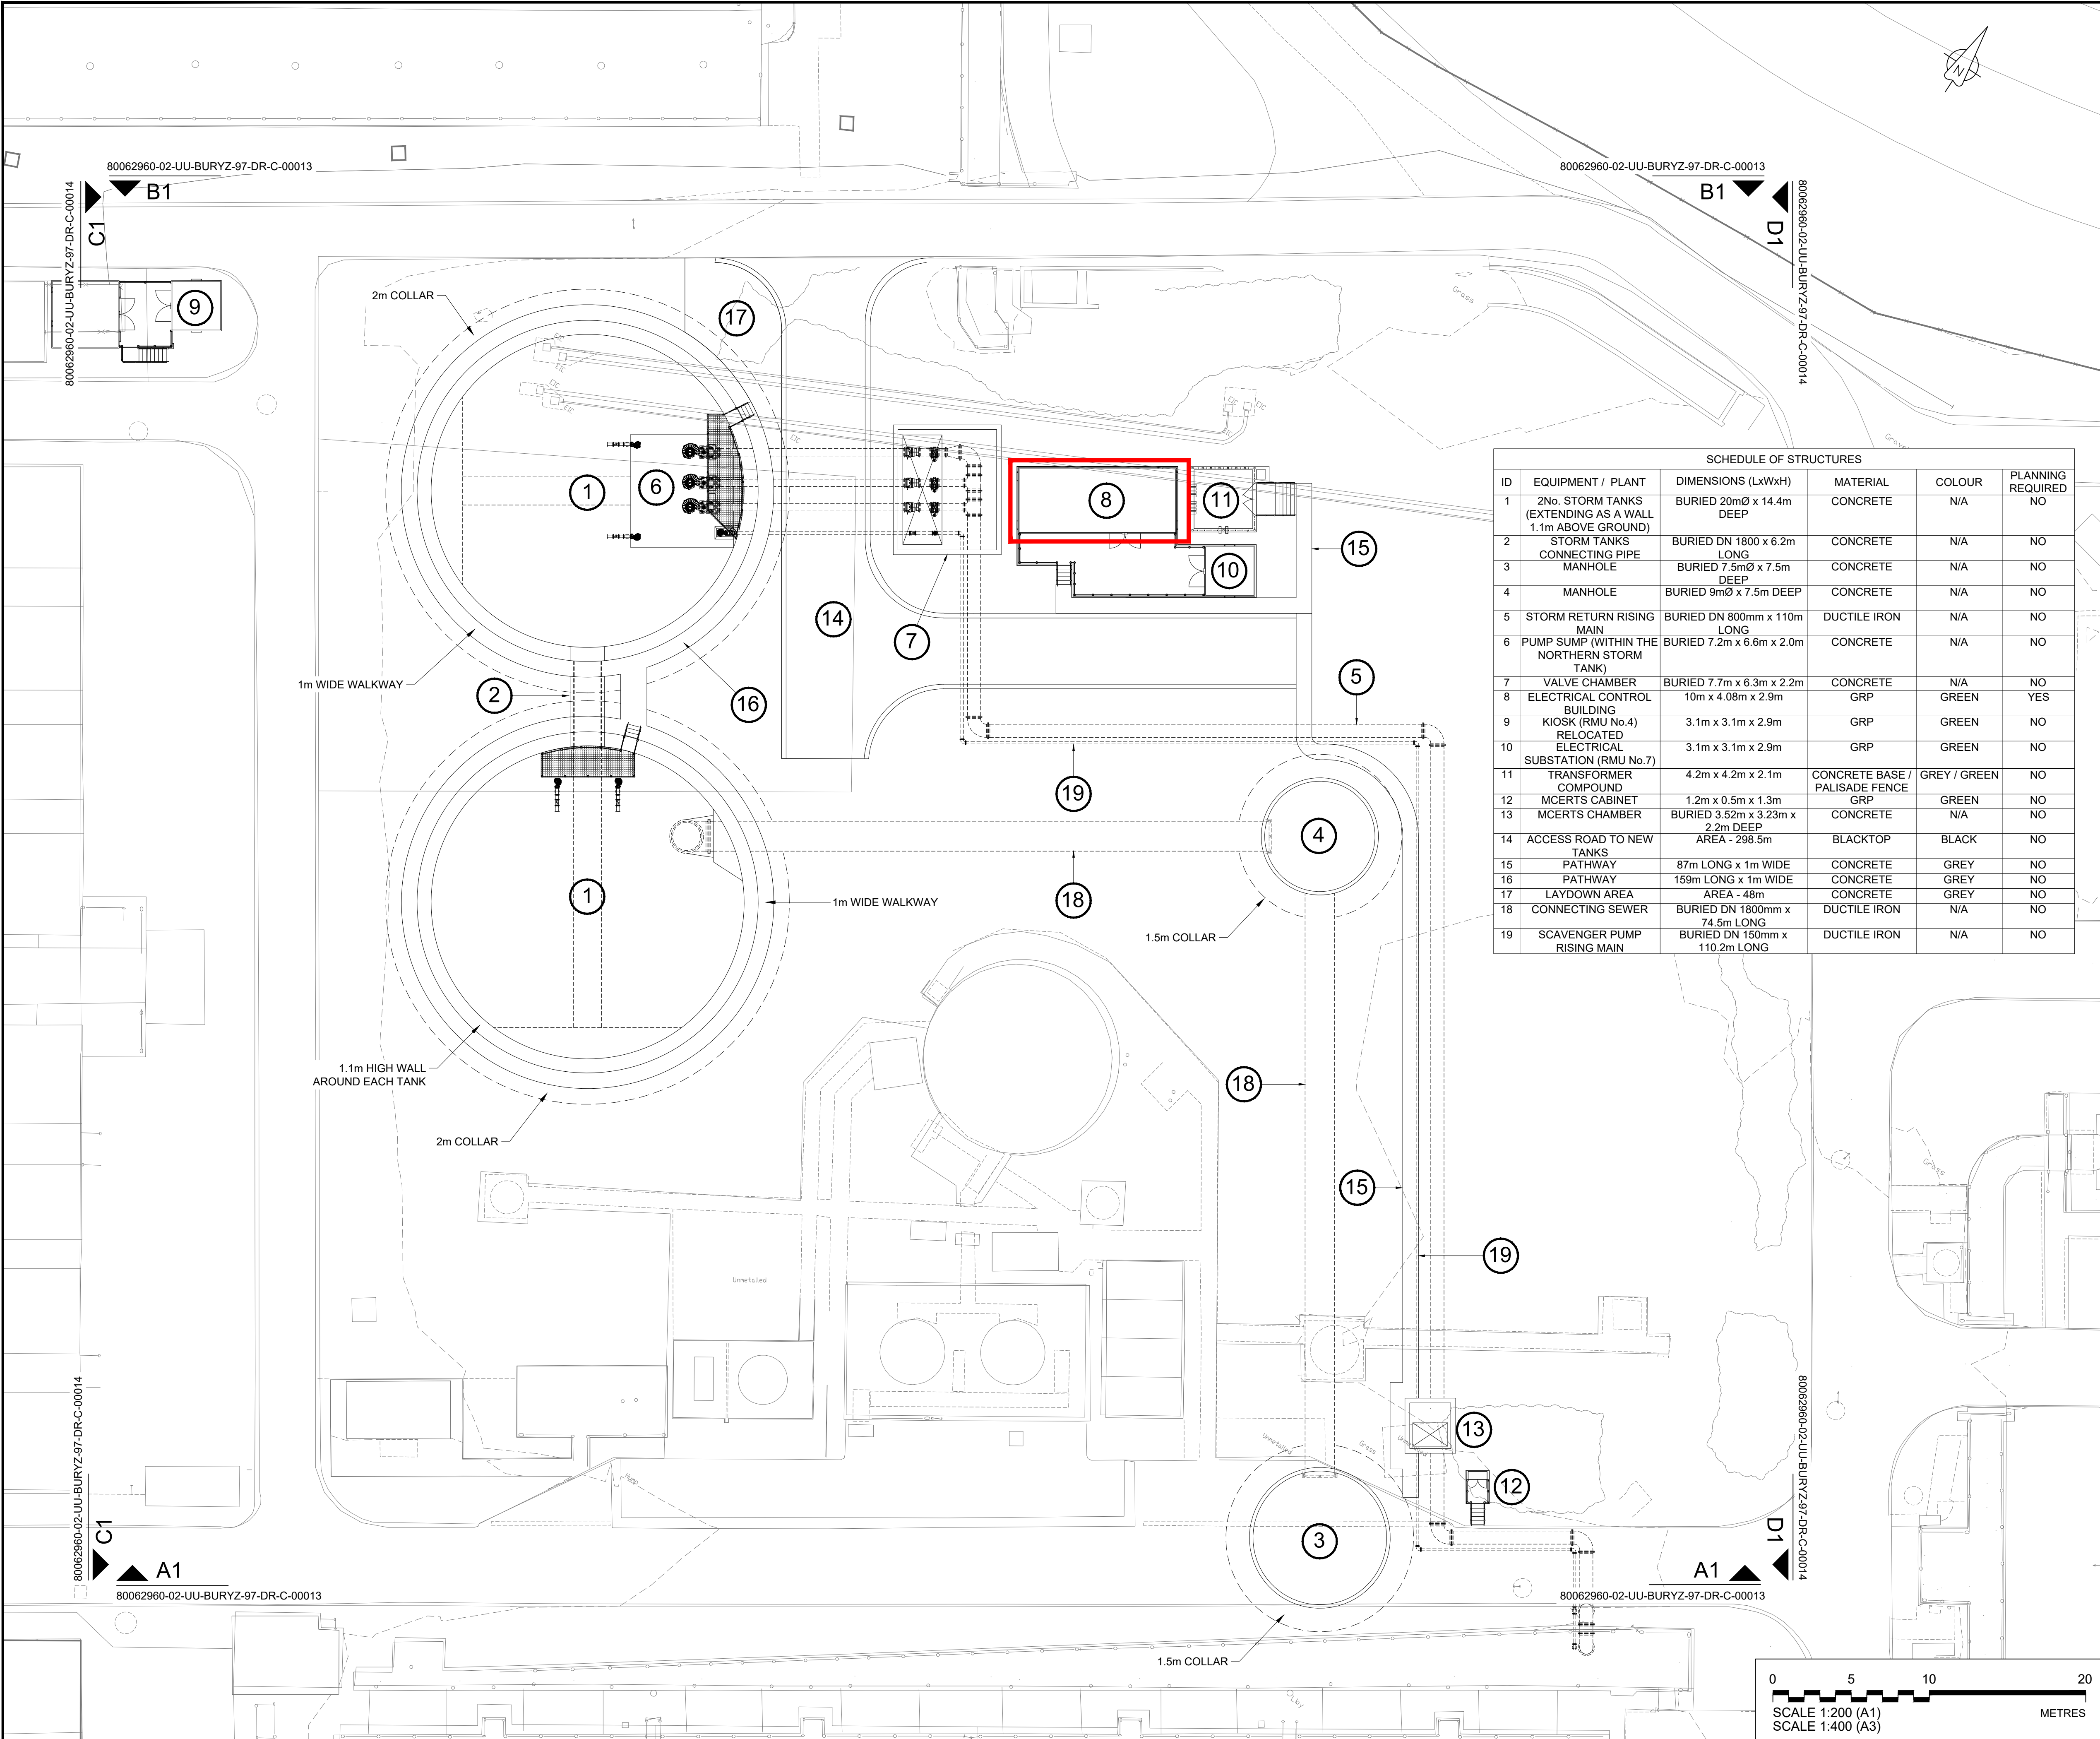

SCHEDULE OF STRUCTURES					
ID	EQUIPMENT / PLANT	DIMENSIONS (LxWxH)	MATERIAL	COLOUR	PLANNING REQUIRED
1	2No. STORM TANKS (EXTENDING AS A WALL 1.1m ABOVE GROUND)	BURIED 20mØ x 14.4m DEEP	CONCRETE	N/A	NO
2	STORM TANKS	BURIED DN 1800 x 6.2m LONG	CONCRETE	N/A	NO
3	CONNECTING PIPE MANHOLE	BURIED 7.5mØ x 7.5m DEEP	CONCRETE	N/A	NO
4	MANHOLE	BURIED 9mØ x 7.5m DEEP	CONCRETE	N/A	NO
5	STORM RETURN RISING MAIN	BURIED DN 800mm x 110m LONG	DUCTILE IRON	N/A	NO
6	PUMP SUMP (WITHIN THE NORTHERN STORM TANK)	BURIED 7.2m x 6.6m x 2.0m	CONCRETE	N/A	NO
7	VALVE CHAMBER	BURIED 7.7m x 6.3m x 2.2m	CONCRETE	N/A	NO
8	ELECTRICAL CONTROL BUILDING	10m x 4.08m x 2.9m	GRP	GREEN	YES
9	KIOSK (RMU No.4) RELOCATED	3.1m x 3.1m x 2.9m	GRP	GREEN	NO
10	ELECTRICAL SUBSTATION (RMU No.7)	3.1m x 3.1m x 2.9m	GRP	GREEN	NO
11	TRANSFORMER COMPOUND	4.2m x 4.2m x 2.1m	CONCRETE BASE / PALISADE FENCE	GREY / GREEN	NO
12	MCERTS CABINET	1.2m x 0.5m x 1.3m	GRP	GREEN	NO
13	MCERTS CHAMBER	BURIED 3.52m x 3.23m x 2.2m DEEP	CONCRETE	N/A	NO
14	ACCESS ROAD TO NEW TANKS	AREA - 298.5m	BLACKTOP	BLACK	NO
15	PATHWAY	87m LONG x 1m WIDE	CONCRETE	GREY	NO
16	PATHWAY	159m LONG x 1m WIDE	CONCRETE	GREY	NO
17	LAYDOWN AREA	AREA - 48m	CONCRETE	GREY	NO
18	CONNECTING SEWER	BURIED DN 1800mm x 74.5m LONG	DUCTILE IRON	N/A	NO
19	SCAVENGER PUMP RISING MAIN	BURIED DN 150mm x 110.2m LONG	DUCTILE IRON	N/A	NO

- NOTES:
- ALL DIMENSIONS AND LEVELS ARE IN METRES AOD UNLESS NOTED OTHERWISE.
 - REFER TO DRAWING No's:
80062960-02-UU-BURYZ-97-DR-C-00013 - PROPOSED SITE ELEVATIONS SHEET 1 OF 2.
80062960-02-UU-BURYZ-97-DR-C-00014 - PROPOSED SITE ELEVATIONS SHEET 2 OF 2.

LEGEND:

PLANNING APPLICATION RED LINE BOUNDARY

CURRENT ISSUE INFORMATION

P03	KA	NG	NG	For Information	08/06/23
VERSION	AUTH	CHD	REVD	REASON FOR ISSUE	DATE
S2				Issued for Information	
SUITABILITY CODE	SUITABILITY DESCRIPTION				



GREEN RECOVERY BURY WwTW STORM TANKS

BURY WwTW SCHEME

PLANNING APPLICATION

PROPOSED SITE LAYOUT

SCALE 1:200	SHEET SIZE A1
DRAWING NUMBER 80062960-02-UU-BURYZ-97-DR-C-00012	REVISION P03