


File name \\UK\WSPGROUP\COMCENTRAL DATA\PROJECTS\70092923 - RADCLIFFE CIVIC HUB\03 WIP\LIGHTING\04 DRAWINGS\RADHUB-WSP-XX-XX-DR-Y-0001.DWG, printed on 30 May 2024 09:39:30, by Branson, Steven



THE TEMPORARY LIGHTING SOLUTIONS FOR BOTH CHURCH STREET AND DALE STREET RADCLIFFE ACHIEVES THE REQUIREMENTS OF BS5489-1:2020 FOR LIGHTING CLASSIFICATION OF P1 (EAV=15.00 TO 22.50 LUX, EMIN= 3.00 LUX) AS AGREED WITH BMBC.

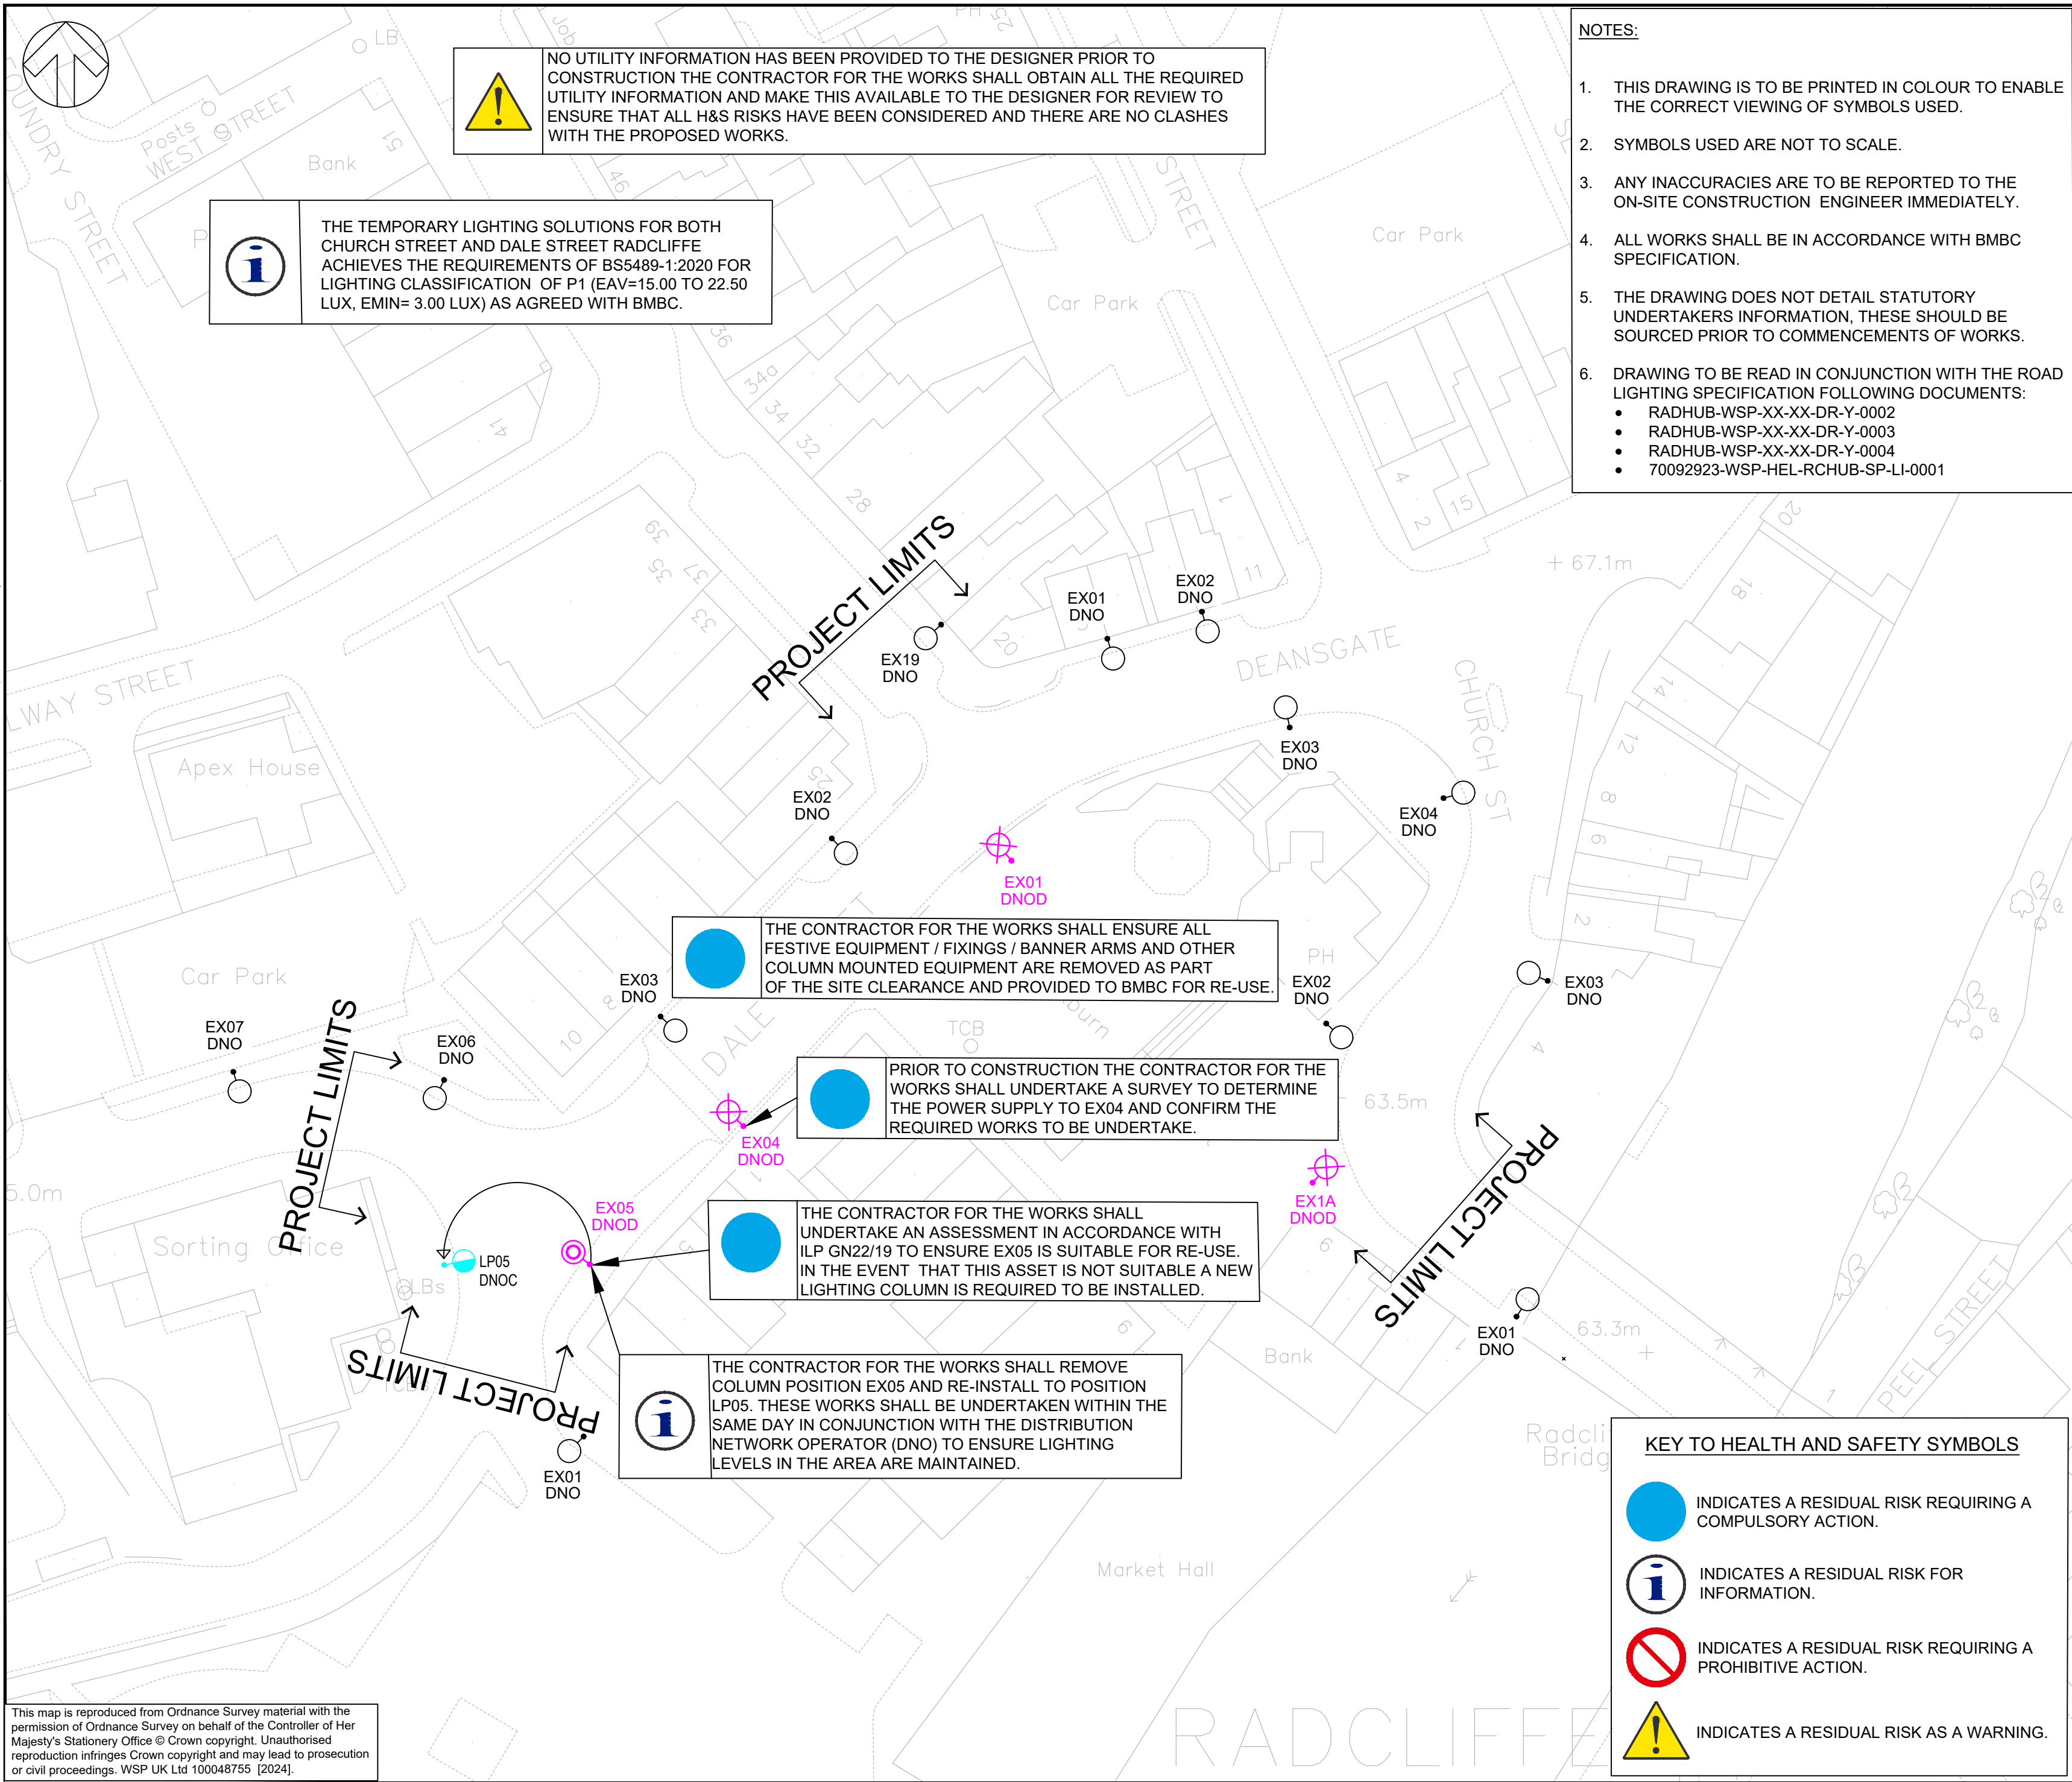

NO UTILITY INFORMATION HAS BEEN PROVIDED TO THE DESIGNER PRIOR TO CONSTRUCTION THE CONTRACTOR FOR THE WORKS SHALL OBTAIN ALL THE REQUIRED UTILITY INFORMATION AND MAKE THIS AVAILABLE TO THE DESIGNER FOR REVIEW TO ENSURE THAT ALL H&S RISKS HAVE BEEN CONSIDERED AND THERE ARE NO CLASHES WITH THE PROPOSED WORKS.



THE CONTRACTOR FOR THE WORKS SHALL ENSURE ALL FESTIVE EQUIPMENT / FIXINGS / BANNER ARMS AND OTHER COLUMN MOUNTED EQUIPMENT ARE REMOVED AS PART OF THE SITE CLEARANCE AND PROVIDED TO BMBC FOR RE-USE.



PRIOR TO CONSTRUCTION THE CONTRACTOR FOR THE WORKS SHALL UNDERTAKE A SURVEY TO DETERMINE THE POWER SUPPLY TO EX04 AND CONFIRM THE REQUIRED WORKS TO BE UNDERTAKE.



THE CONTRACTOR FOR THE WORKS SHALL UNDERTAKE AN ASSESSMENT IN ACCORDANCE WITH ILP GN22/19 TO ENSURE EX05 IS SUITABLE FOR RE-USE. IN THE EVENT THAT THIS ASSET IS NOT SUITABLE A NEW LIGHTING COLUMN IS REQUIRED TO BE INSTALLED.



THE CONTRACTOR FOR THE WORKS SHALL REMOVE COLUMN POSITION EX05 AND RE-INSTALL TO POSITION LP05. THESE WORKS SHALL BE UNDERTAKEN WITHIN THE SAME DAY IN CONJUNCTION WITH THE DISTRIBUTION NETWORK OPERATOR (DNO) TO ENSURE LIGHTING LEVELS IN THE AREA ARE MAINTAINED.

NOTES:

- THIS DRAWING IS TO BE PRINTED IN COLOUR TO ENABLE THE CORRECT VIEWING OF SYMBOLS USED.
- SYMBOLS USED ARE NOT TO SCALE.
- ANY INACCURACIES ARE TO BE REPORTED TO THE ON-SITE CONSTRUCTION ENGINEER IMMEDIATELY.
- ALL WORKS SHALL BE IN ACCORDANCE WITH BMBC SPECIFICATION.
- THE DRAWING DOES NOT DETAIL STATUTORY UNDERTAKERS INFORMATION, THESE SHOULD BE SOURCED PRIOR TO COMMENCEMENTS OF WORKS.
- DRAWING TO BE READ IN CONJUNCTION WITH THE ROAD LIGHTING SPECIFICATION FOLLOWING DOCUMENTS:
 - RADHUB-WSP-XX-XX-DR-Y-0002
 - RADHUB-WSP-XX-XX-DR-Y-0003
 - RADHUB-WSP-XX-XX-DR-Y-0004
 - 70092923-WSP-HEL-RCHUB-SP-LI-0001

KEY TO HEALTH AND SAFETY SYMBOLS



INDICATES A RESIDUAL RISK REQUIRING A COMPULSORY ACTION.



INDICATES A RESIDUAL RISK FOR INFORMATION.



INDICATES A RESIDUAL RISK REQUIRING A PROHIBITIVE ACTION.



INDICATES A RESIDUAL RISK AS A WARNING.

DO NOT SCALE

KEY



EXISTING COLUMN AND LUMINAIRE TO REMAIN.



TAKE UP OR DOWN AND REMOVE TO STORE FOR RE-USE EXISTING ROAD LIGHTING COLUMN (8M NOMINAL HEIGHT) AND LUMINAIRE .



TAKE UP OR DOWN AND REMOVE OFF SITE TO TIP EXISTING ROAD LIGHTING COLUMN (10M NOMINAL HEIGHT) INCLUDING LUMINAIRE AND BRACKET.



REMOVE FROM STORE AND RE-ERECT EXISTING ROAD LIGHTING COLUMN (8M NOMINAL HEIGHT) AND LUMNAIRE.

DNO

DISTRIBUTION NETWORK OPERATOR SUPPLY TO REMAIN.

DNOD

DISTRIBUTION NETWORK OPERATOR SUPPLY TO DISCONNECT REQUIRED.

DNOC

DISTRIBUTION NETWORK OPERATOR NEW CONNECTION REQUIRED.

REV	DATE	BY	DESCRIPTION	CHK	APP
P02	30.05.24		PROJECT NAMING CONVENTION CHANGED		
P01	24.02.23	SB	FIRST ISSUE	OW	MC

DRAWING STATUS:	S3 - FOR REVIEW
-----------------	-----------------



8 First Street, Manchester, M15 4GU, UK
T+ 44 (0) 161 200 5000
wsp.com

CLIENT:	VINCI CONSTRUCTION
---------	--------------------

ARCHITECT:	-
------------	---

PROJECT:	RADCLIFFE CIVIC HUB
----------	---------------------

TITLE:	ROAD LIGHTING TEMPORARY & SITE CLEARANCE LAYOUT SHEET 1 OF 1
--------	--

SCALE @ A2:	1:500	CHECKED:	OC	APPROVED:	MC
PROJECT No:	70092923	DESIGNED:	SB	DRAWN:	SB
DRAWING No:	RADHUB-WSP-XX-XX-DR-Y-0001	DATE:	May 24	REV:	P02

© WSP UK Ltd