

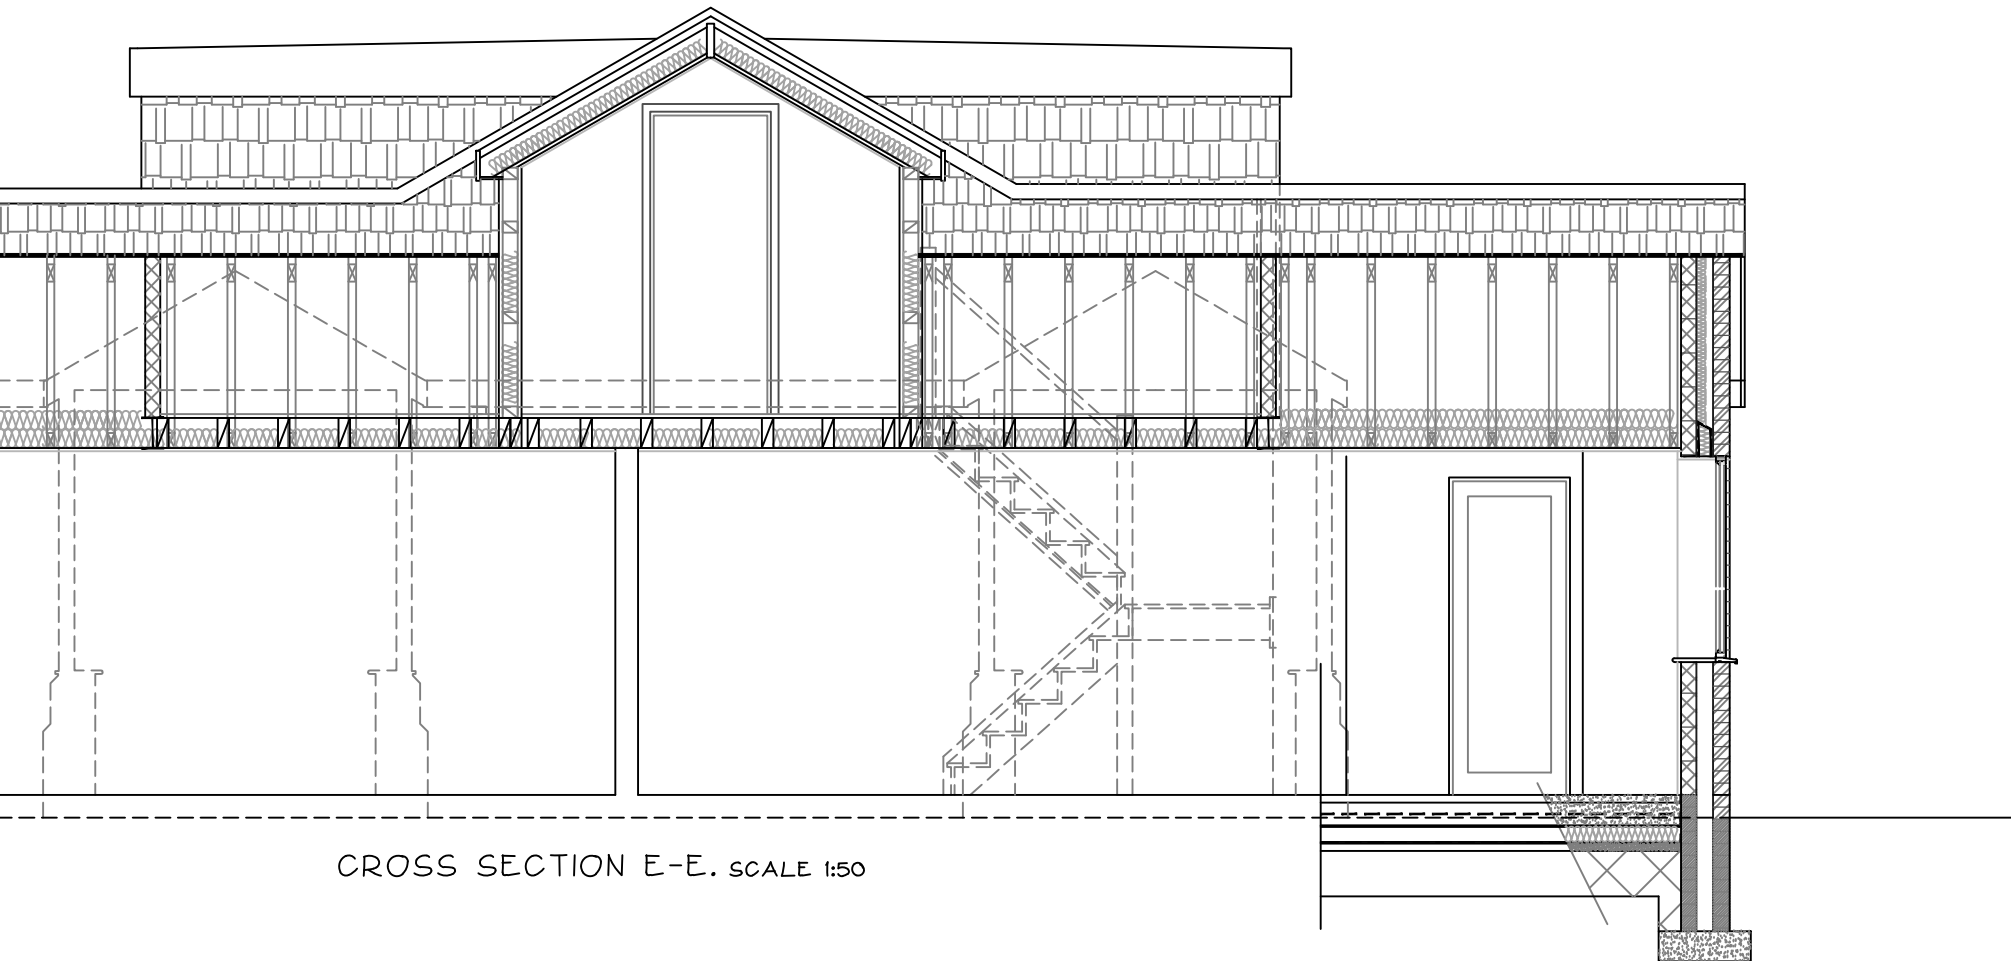
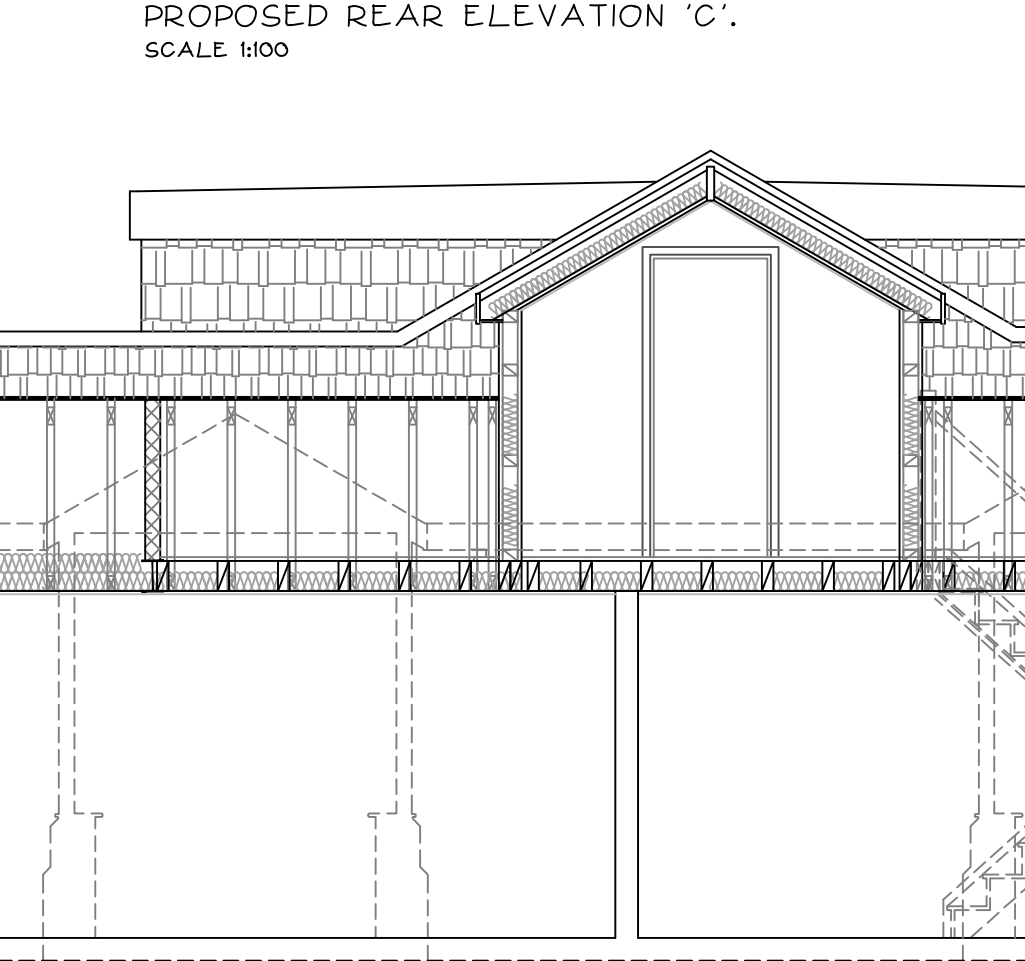
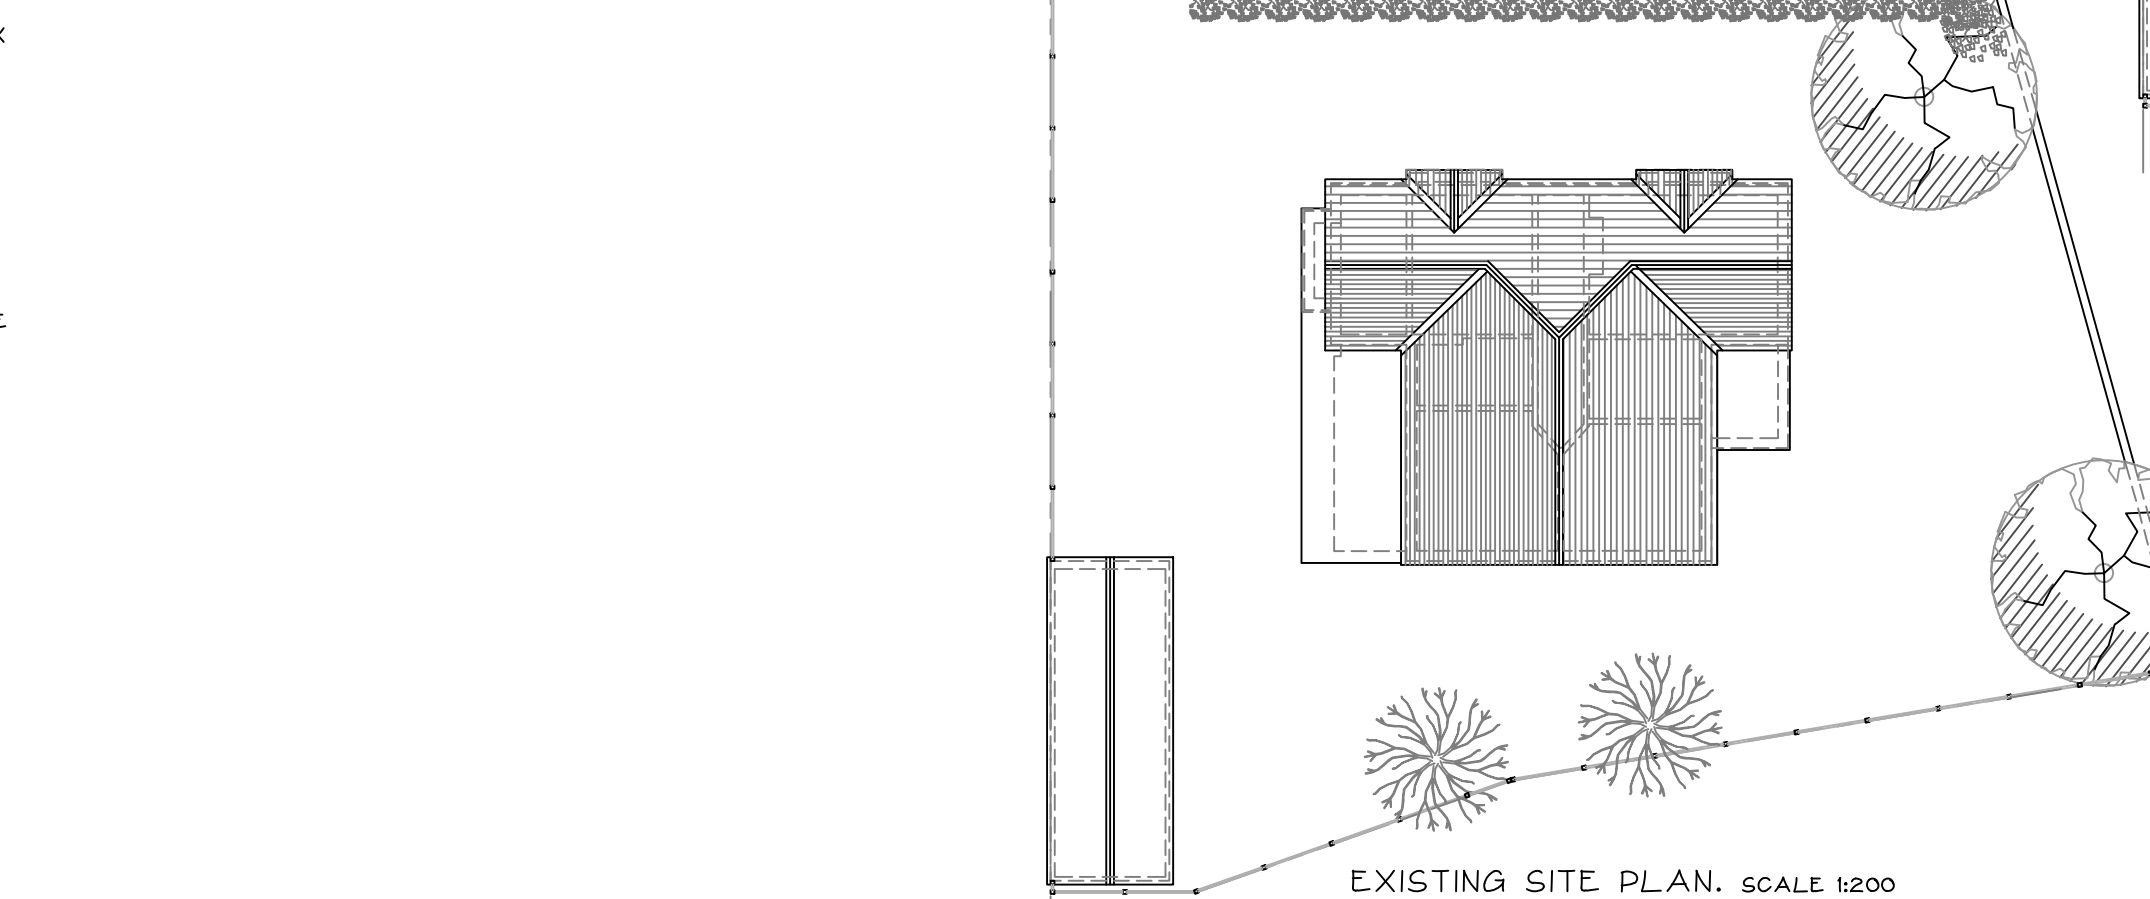
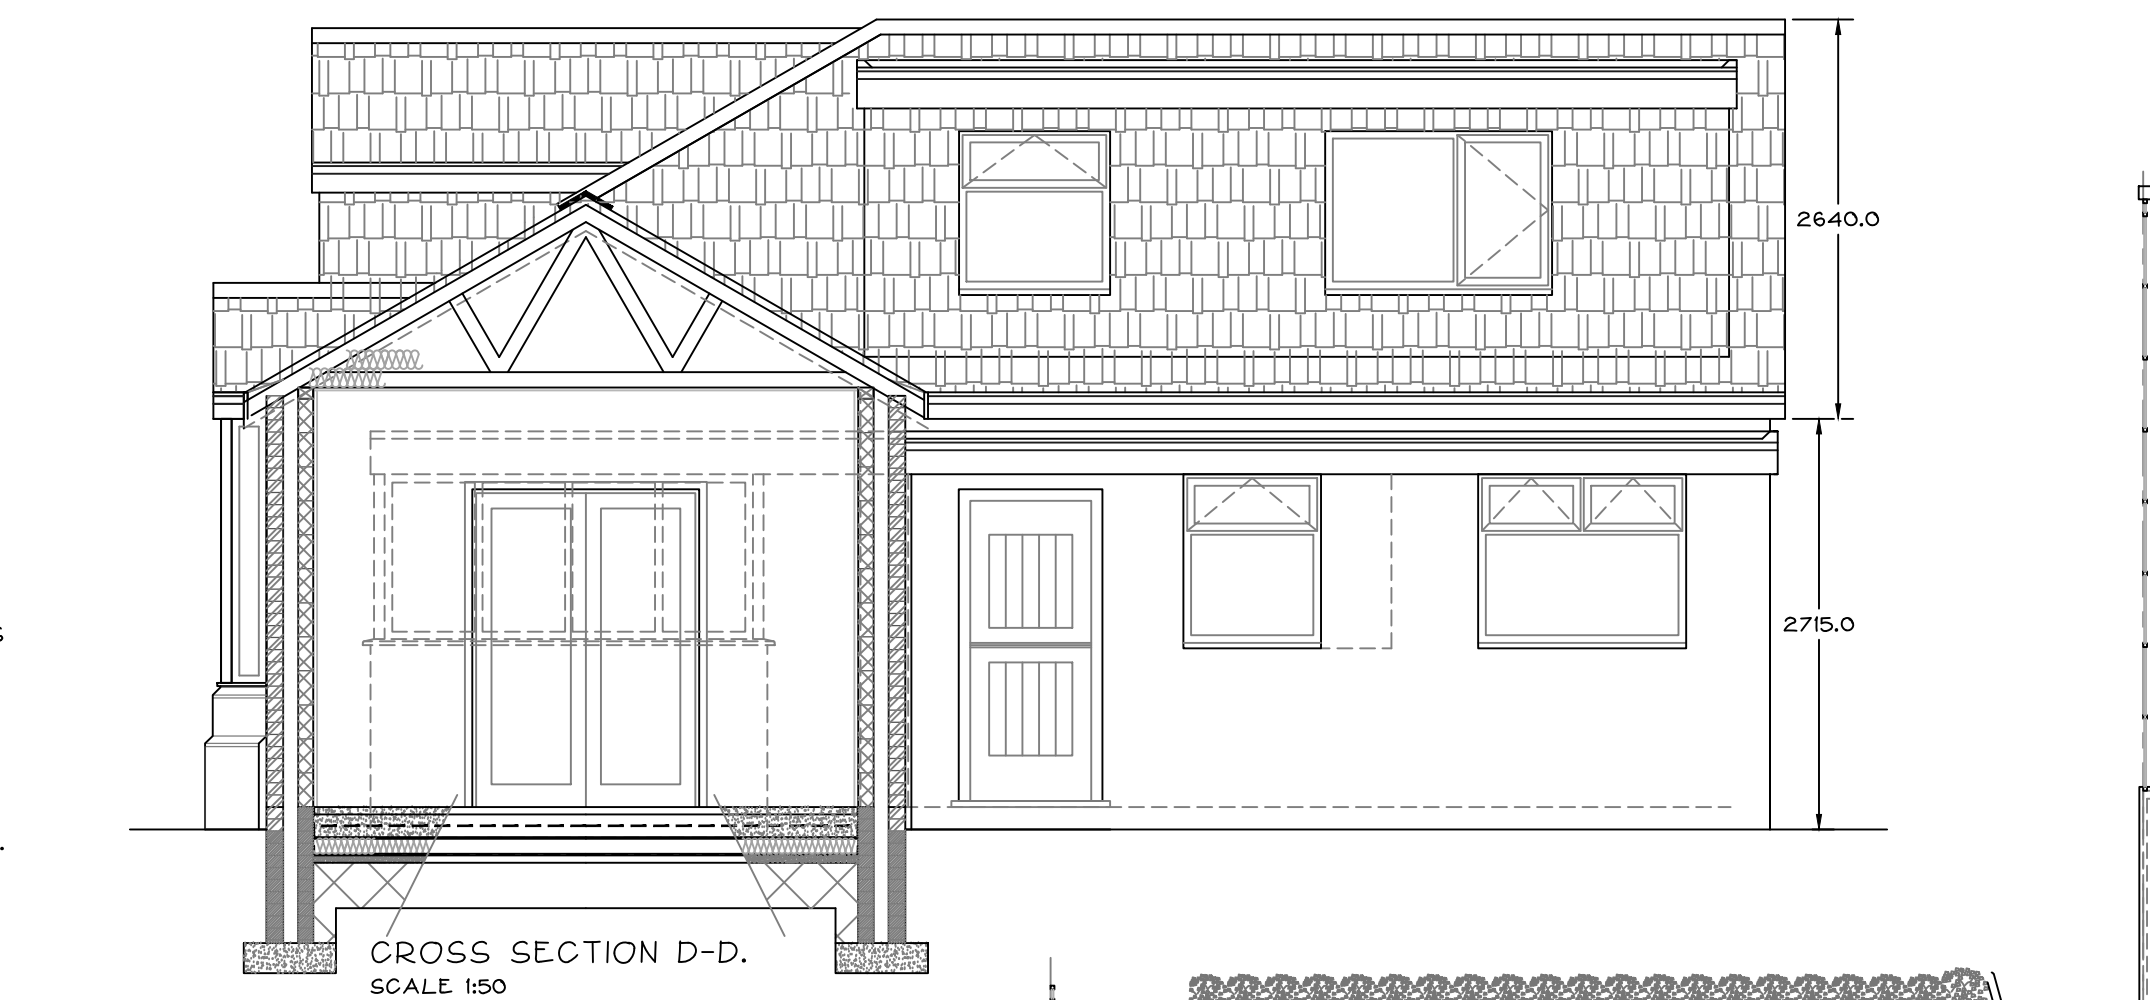
3. INTERNAL WASTE PIPES:
W.C. TO HAVE P-TRAP AND CONNECTED TO SOIL AND VENT PIPE. WASH HAND BASIN TO HAVE 32MM DIA WASTE OUTLET TO 75MM DEEP SEAL ANTI VAC TRAP TO 32MM DIA WASTE TO BACKWATER INLET Gully, (B.I.G.) TO INSPECTION CHAMBER, (I.C.) TO CHEN SHEN TO 100MM DIA TO 32MM DIA WASTE TO B.I.G. EXTERNALLY MOUNTED 100MM DIA SOIL AND VENT PIPE TO 100MM DIA SUPERSLEEVE DRAIN OR SIMILAR APPROVED TO NEW I.C. WHERE REQUIRED PROVIDE RODDING EYES AT BENDS OF PIPES. INSPECTION CHAMBERS UP TO 650MM DEEP TO BE VITRIFIED CLAY OR POLYPROPYLENE, UP TO 950MM DEEP TO BE POLYPROPYLENE. ALL PIPES TO BE 150MM DIA. ALL CAST CONCRETE SECTIONS. ALL NEW HIGHWAY WORKS TO BE TO LOCAL AUTHORITY SPECIFICATION.

ALL ELECTRICAL WORK REQUIRED TO MEET THE REQUIREMENTS OF PART 'P' (ELECTRICAL SAFETY) MUST BE DESIGNED, INSTALLED, INSPECTED AND TESTED BY A PERSON COMPETENT TO DO SO. PRIOR TO COMPLETION THE APPOINTED BUILDING INSPECTOR SHOULD BE SATISFIED THAT THE PART 'P' HAS BEEN FULLY COMPLIED WITH. THIS MAY REQUIRE AN APPROPRIATE B.S. 7671 ELECTRICAL INSTALLATION CERTIFICATE TO BE ISSUED FOR THE WORKS BY A PERSON COMPETENT TO DO SO.

6. SMOKE DETECTION:

TO BE PROVIDED AS INDICATED ON PLAN LAYOUT. DETECTORS TO BE LINKED, PERMANENTLY WIRED TO A SEPARATE FUSE ON THE DISTRIBUTION BOARD AND HAVE BATTERY BACK-UP, ALL TO BS 5446 PART 1 AND FITTED IN STRICT ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND INSTRUCTIONS.

CONTRACTOR TO TAKE ALL RELEVANT
SITE DIMENSIONS PRIOR TO STARTING ANY
STRUCTURAL WORK AND PLACING ORDERS
FOR MATERIALS. ANY DISCREPANCIES TO BE
BROUGHT TO THE ATTENTION OF THE
ARCHITECT.

[illegible][illegible]

PROPOSED CROSS SECTION DETAILS,
GENERAL CONSTRUCTION NOTES AND
PROPOSED ELEVATIONS.

YOUNUS KHAN B.A (HONS) ARCH. DESIGN CONSULTANT
TEL + FAX BLACKBURN 01254 691988. MOBILE 07930 344601

date FEB 2023	drawn	checked	rev
scale 1:10, 1:20, 1:50 1:100	project no. 3632	drawing no. 02	A