


LEGEND

01. Perforated pipe to positively drain tree pit to wider drainage network. To engineers details.
02. Bark mulch 50mm consolidated depth.
03. Topsoil: 300mm to BS3882:2007. To include min. 10% organic matter.
04. Subsoil: 200mm to BS8601:2013.
05. Polypropene reinforcement geogrid - Refer to engineer's pavement details & specification.
06. Irrigation inlet: Aluminium rootrain precinct 100 (circular) by Green Blue Urban Ltd or similar approved.
07. High density polyethylene root barrier. Re-root 1000 or acceptable equivalent.
08. Deadman guying system. AnchorPlate SASAPXA by GreenBlueUrban Ltd. or acceptable equivalent. Rootball to be protected from contact with supporting wires. Final guying detail to be agreed onsite.
09. Crushed Granite aggregate to improve drainage. 14mm Gauge. NO FINES. Laid on a camber.
10. Base of Pit broken up to improve drainage
- 11A. Topsoil: 400mm to BS3882:2007. To include min. 10% organic matter.
- 11B. Subsoil: 600mm to BS8601:2013.
12. Structural Soil cell. Two tier 400 module depth (875mm overall). RootSpace by GreenBlue Urban or acceptable equivalent.
13. Semi mature tree - refer to Softworks Plan and schedule. Trunk to be wrapped with hessian for two growing seasons
14. Arborslot block infill tray tree surround; DPA/180-180/51/B/75/G2/DG100 or equal approved.
15. Geotextile membrane. Terram 2000 or equal approved.
16. Erosion control gravel, depth to engineer's specification and 50mm consolidated depth. Located to planter edges at kerb inlets.

NOTE: At the commencement of each phase of works, all proposed tree pits within that phase should have a trial pit / slit trench (300mm wide) excavated to establish whether there are any service clashes and to allow trees to be relocated accordingly.

Perculation test to be carried out prior to back filling as per method outlined.

Minimum 5x5x1m - 25m3 per large tree in hard surfacing.
Minimum 3.5x4.3x1m - 15m3 per small tree in hard surfacing.

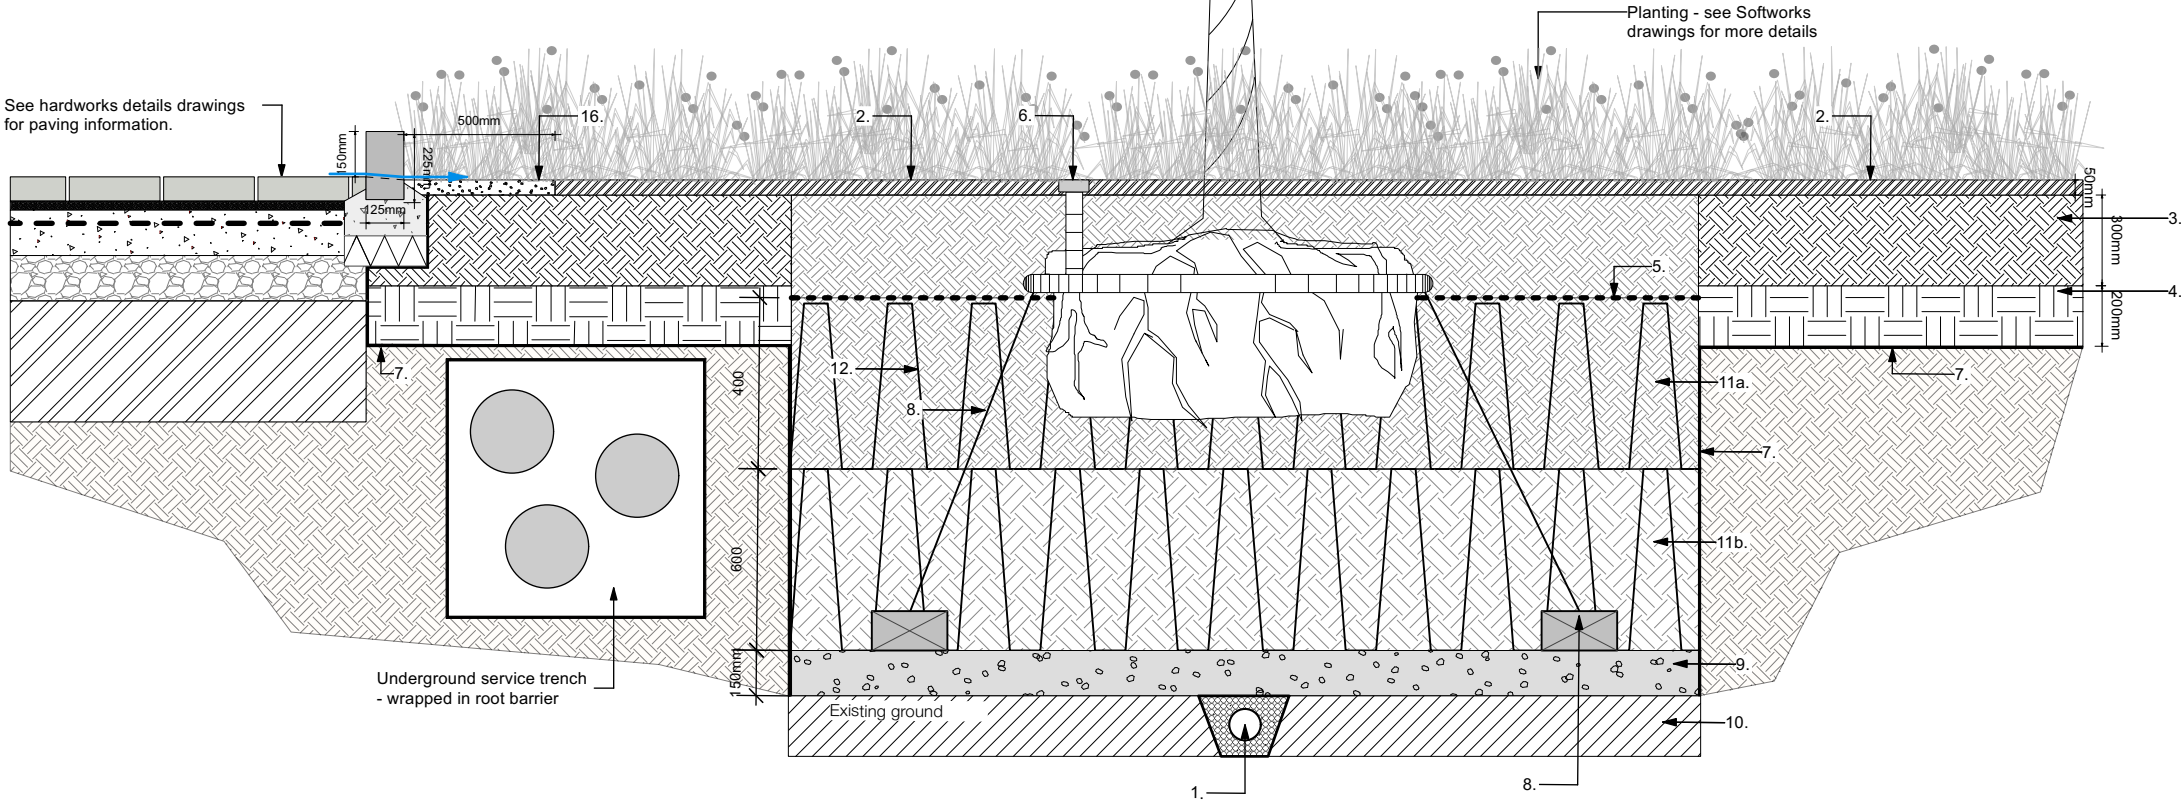

THIS DRAWING IS COPYRIGHT PROTECTED AND MAY NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN AUTHORITY FROM THE OWNER.

- NOTES:
1. Do not scale from this drawing.
 2. Always work to noted dimensions.
 3. All dimensions are in millimetres unless otherwise stated.
 4. All setting out, levels and dimensions to be agreed on site.
 5. The dimensions of all materials must be checked on site before being laid out.
 6. This drawing must be read with the relevant specification clauses and detail drawings.
 7. Order of construction and setting out to be agreed on site.

LOCATION PLAN

KEY

S3-C01	24.04.24	Construction	JTO	RM
S3-P01	01.06.23	Stage 04 Issue	JTO	RM
Revision	Date	Description	Drawn	Apprvd.

Plantit I.E. Limited
E: info@plantit-ie.com W: plantit-ie.com
MANCHESTER
2 Back Grafton St, Altrincham, WA14 1DY
T: 0161 928 9281
LEEDS
No.1 Aire Street, Leeds Station, Leeds, LS1 4PR
T: 0113 624 6413
LIVERPOOL
Tempest 5.3, 12 Tiltham Street, Liverpool, L2 2DT
T: 0151 363 1230
LONDON
Unit 6 Waterside, 44-48 Wharf Road, London, N1 7UX
T: 0207 253 5678
STANDISH
Standish Gatehouse, Stonehouse, Gloucestershire, GL10 3BZ
T: 0145 360 7080

Client Bury Council

Project Radcliffe Hub

Drg Title Details: Central Tree Pit [TP3]

Created on 10.06.22 Created by JTO Approved by RM

Scale 1:25 Size A3 Workstage Construction

Drg No. RADHUB-PIE-00-00-DR-L-6002 S3 Suitability S3 Revision C01

© Plantit I.E. Limited

6002 (above) Section: Central Tree Pit [TP3]
01 Scale: 1:25