


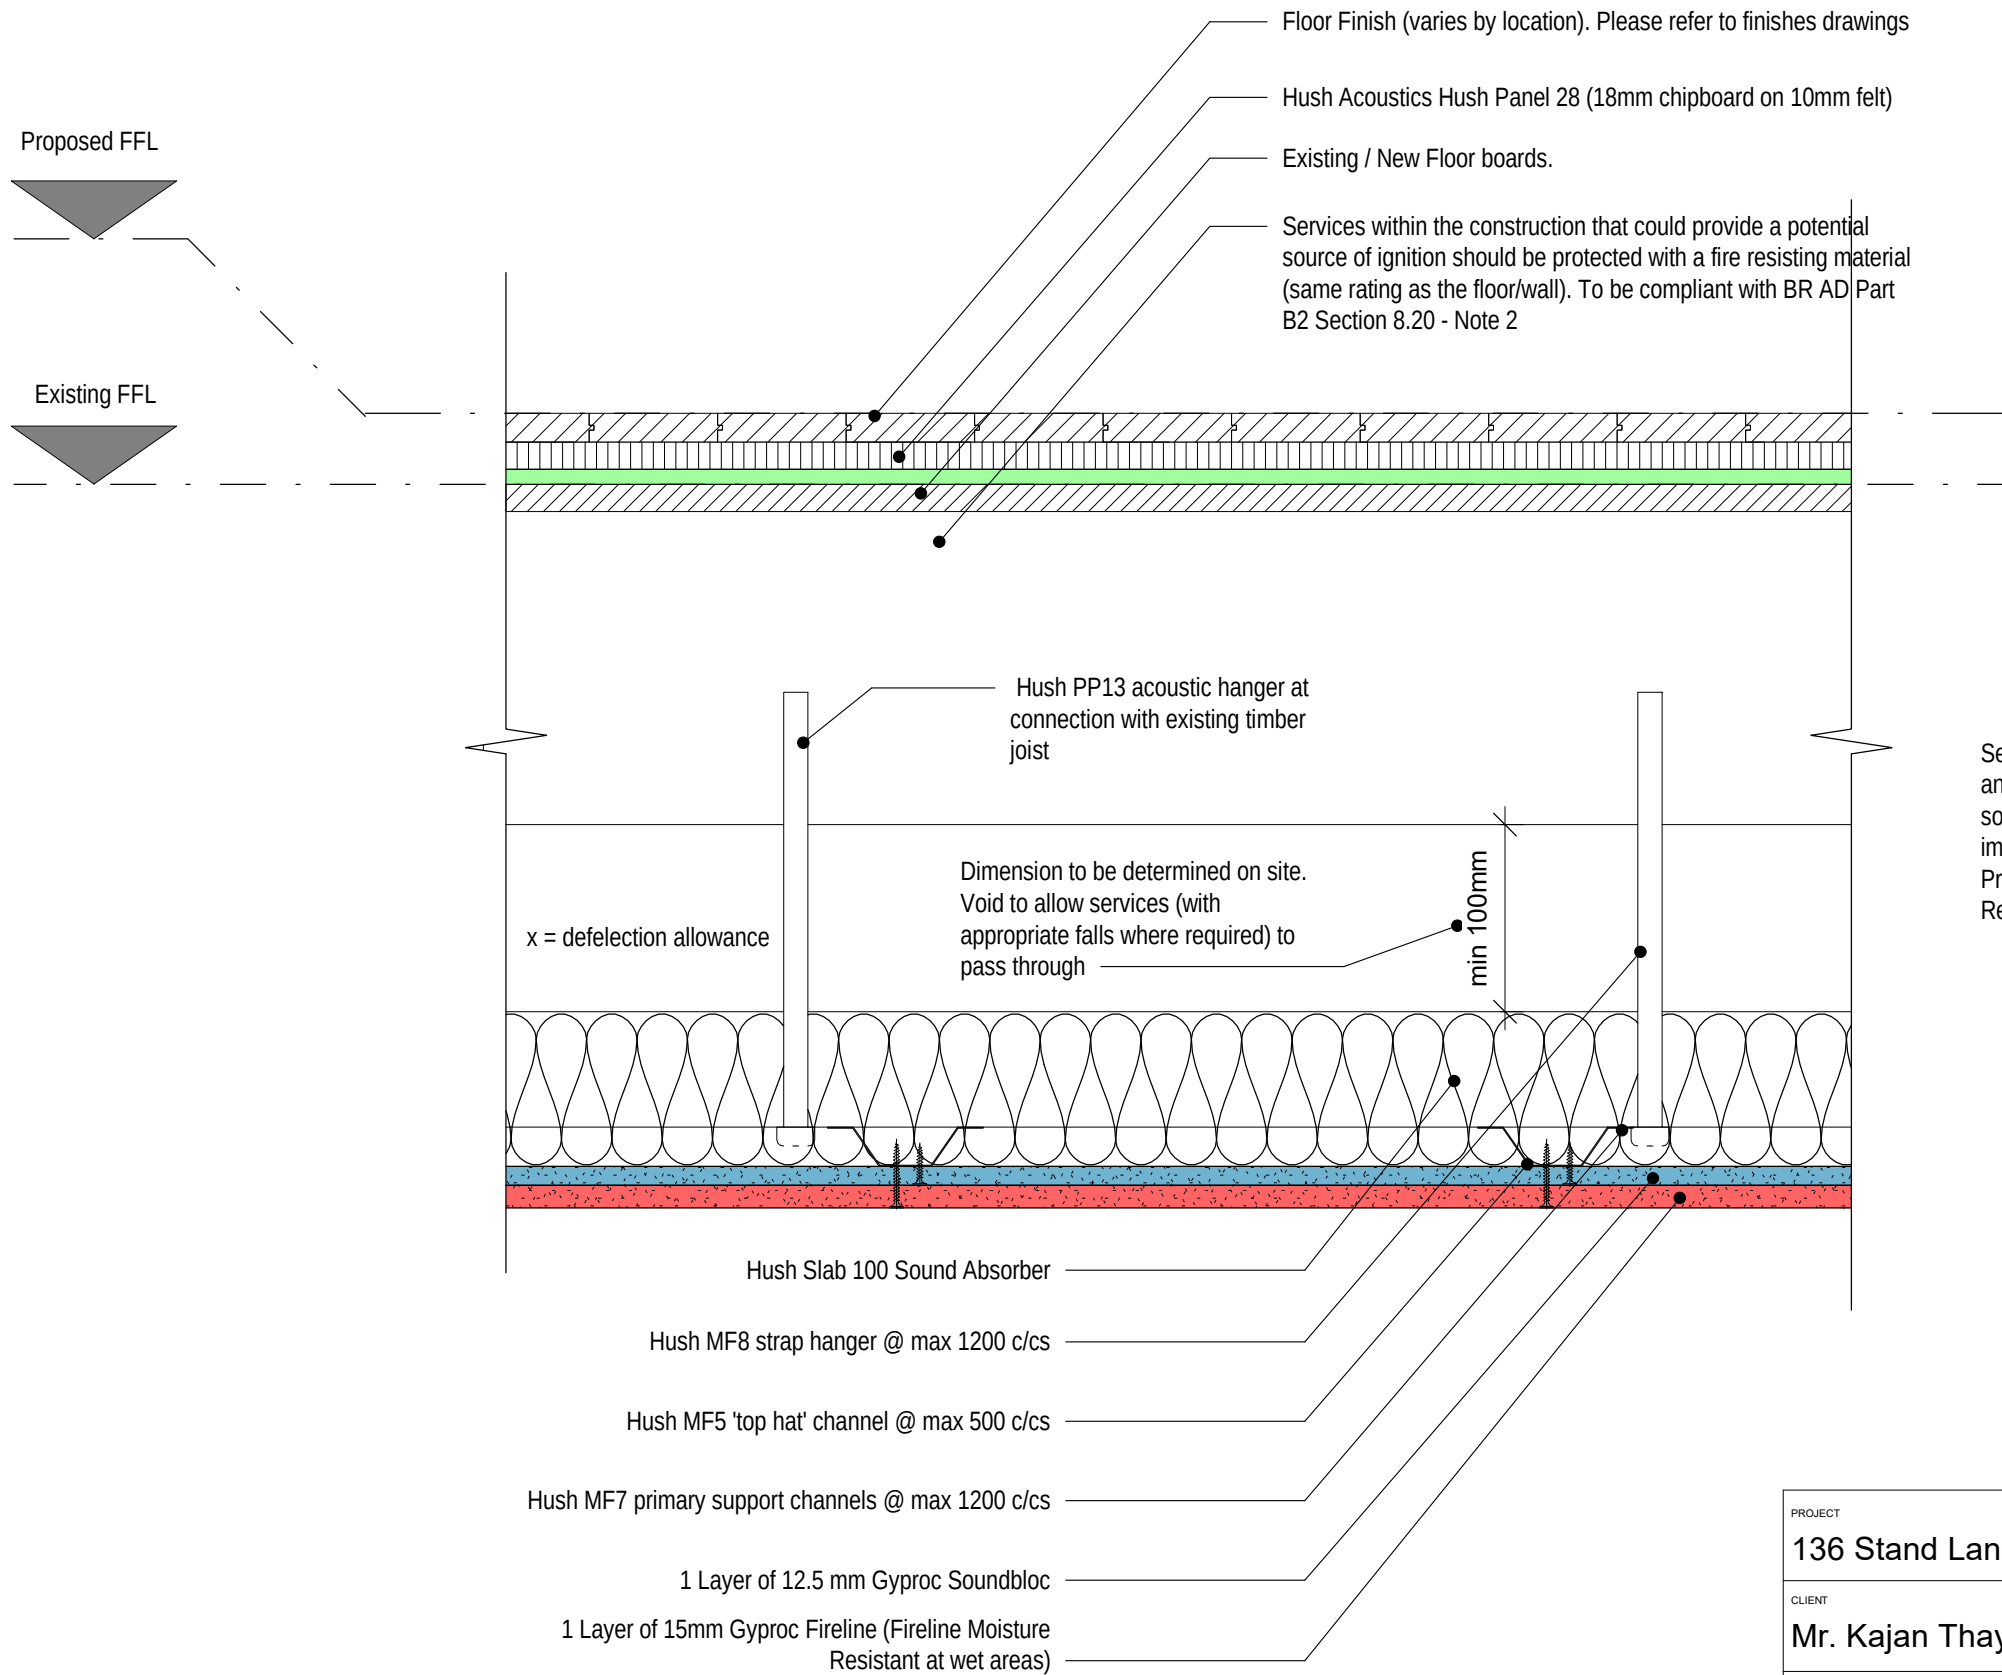

Separating Floor to achieve min. 60mins fire resistance, and comply with Approved Document E in that airborne sound resistance to be min. 43 DnT,w + Ctr dB and impact sound resistance to be Max. 64 L'nT,w dB. Pre-completion testing will be required. Refer to Hush Acoustics System HD1014

REV		DESCRIPTION	BY	DATE
PROJECT		SCALE @ A3	DATE	DRAWN BY
136 Stand Lane		1 : 5	11/05/21	SA
CLIENT		STATUS		
Mr. Kajan Thayalan		PLANNING		
TITLE		PROJECT NO.	DRAWING NO.	REV.
Separating Floor Detail		DA20070.	402.	
NOTES		THIS DRAWING MUST NOT BE REPRODUCED WITHOUT PRIOR WRITTEN CONSENT. DRAWING TO BE USED FOR THE STATUS INDICATED ONLY. ALL DIMENSIONS AND SETTING OUT SHALL BE CHECKED AND CONFIRMED ON SITE. ANY DISCREPANCIES TO BE REPORTED TO THE DESIGNER PRIOR TO THE COMMENCEMENT OF ANY WORK. ALL WORK AND MATERIALS TO BE IN ACCORDANCE WITH CURRENT STATUTORY LEGISLATION, RELEVANT CODES OF PRACTICE AND BRITISH STANDARDS. ALL DIMENSIONS ON THIS DRAWING ARE IN MILLIMETRES (UNLESS OTHERWISE STATED).		