




SITE LOCATION: 425 BURY NEW ROAD, PRESTWICH
LAYOUT PLAN TO ILLUSTRATE PROPOSED VENTILATION SYSTEM - PROPOSAL/DISCUSSION

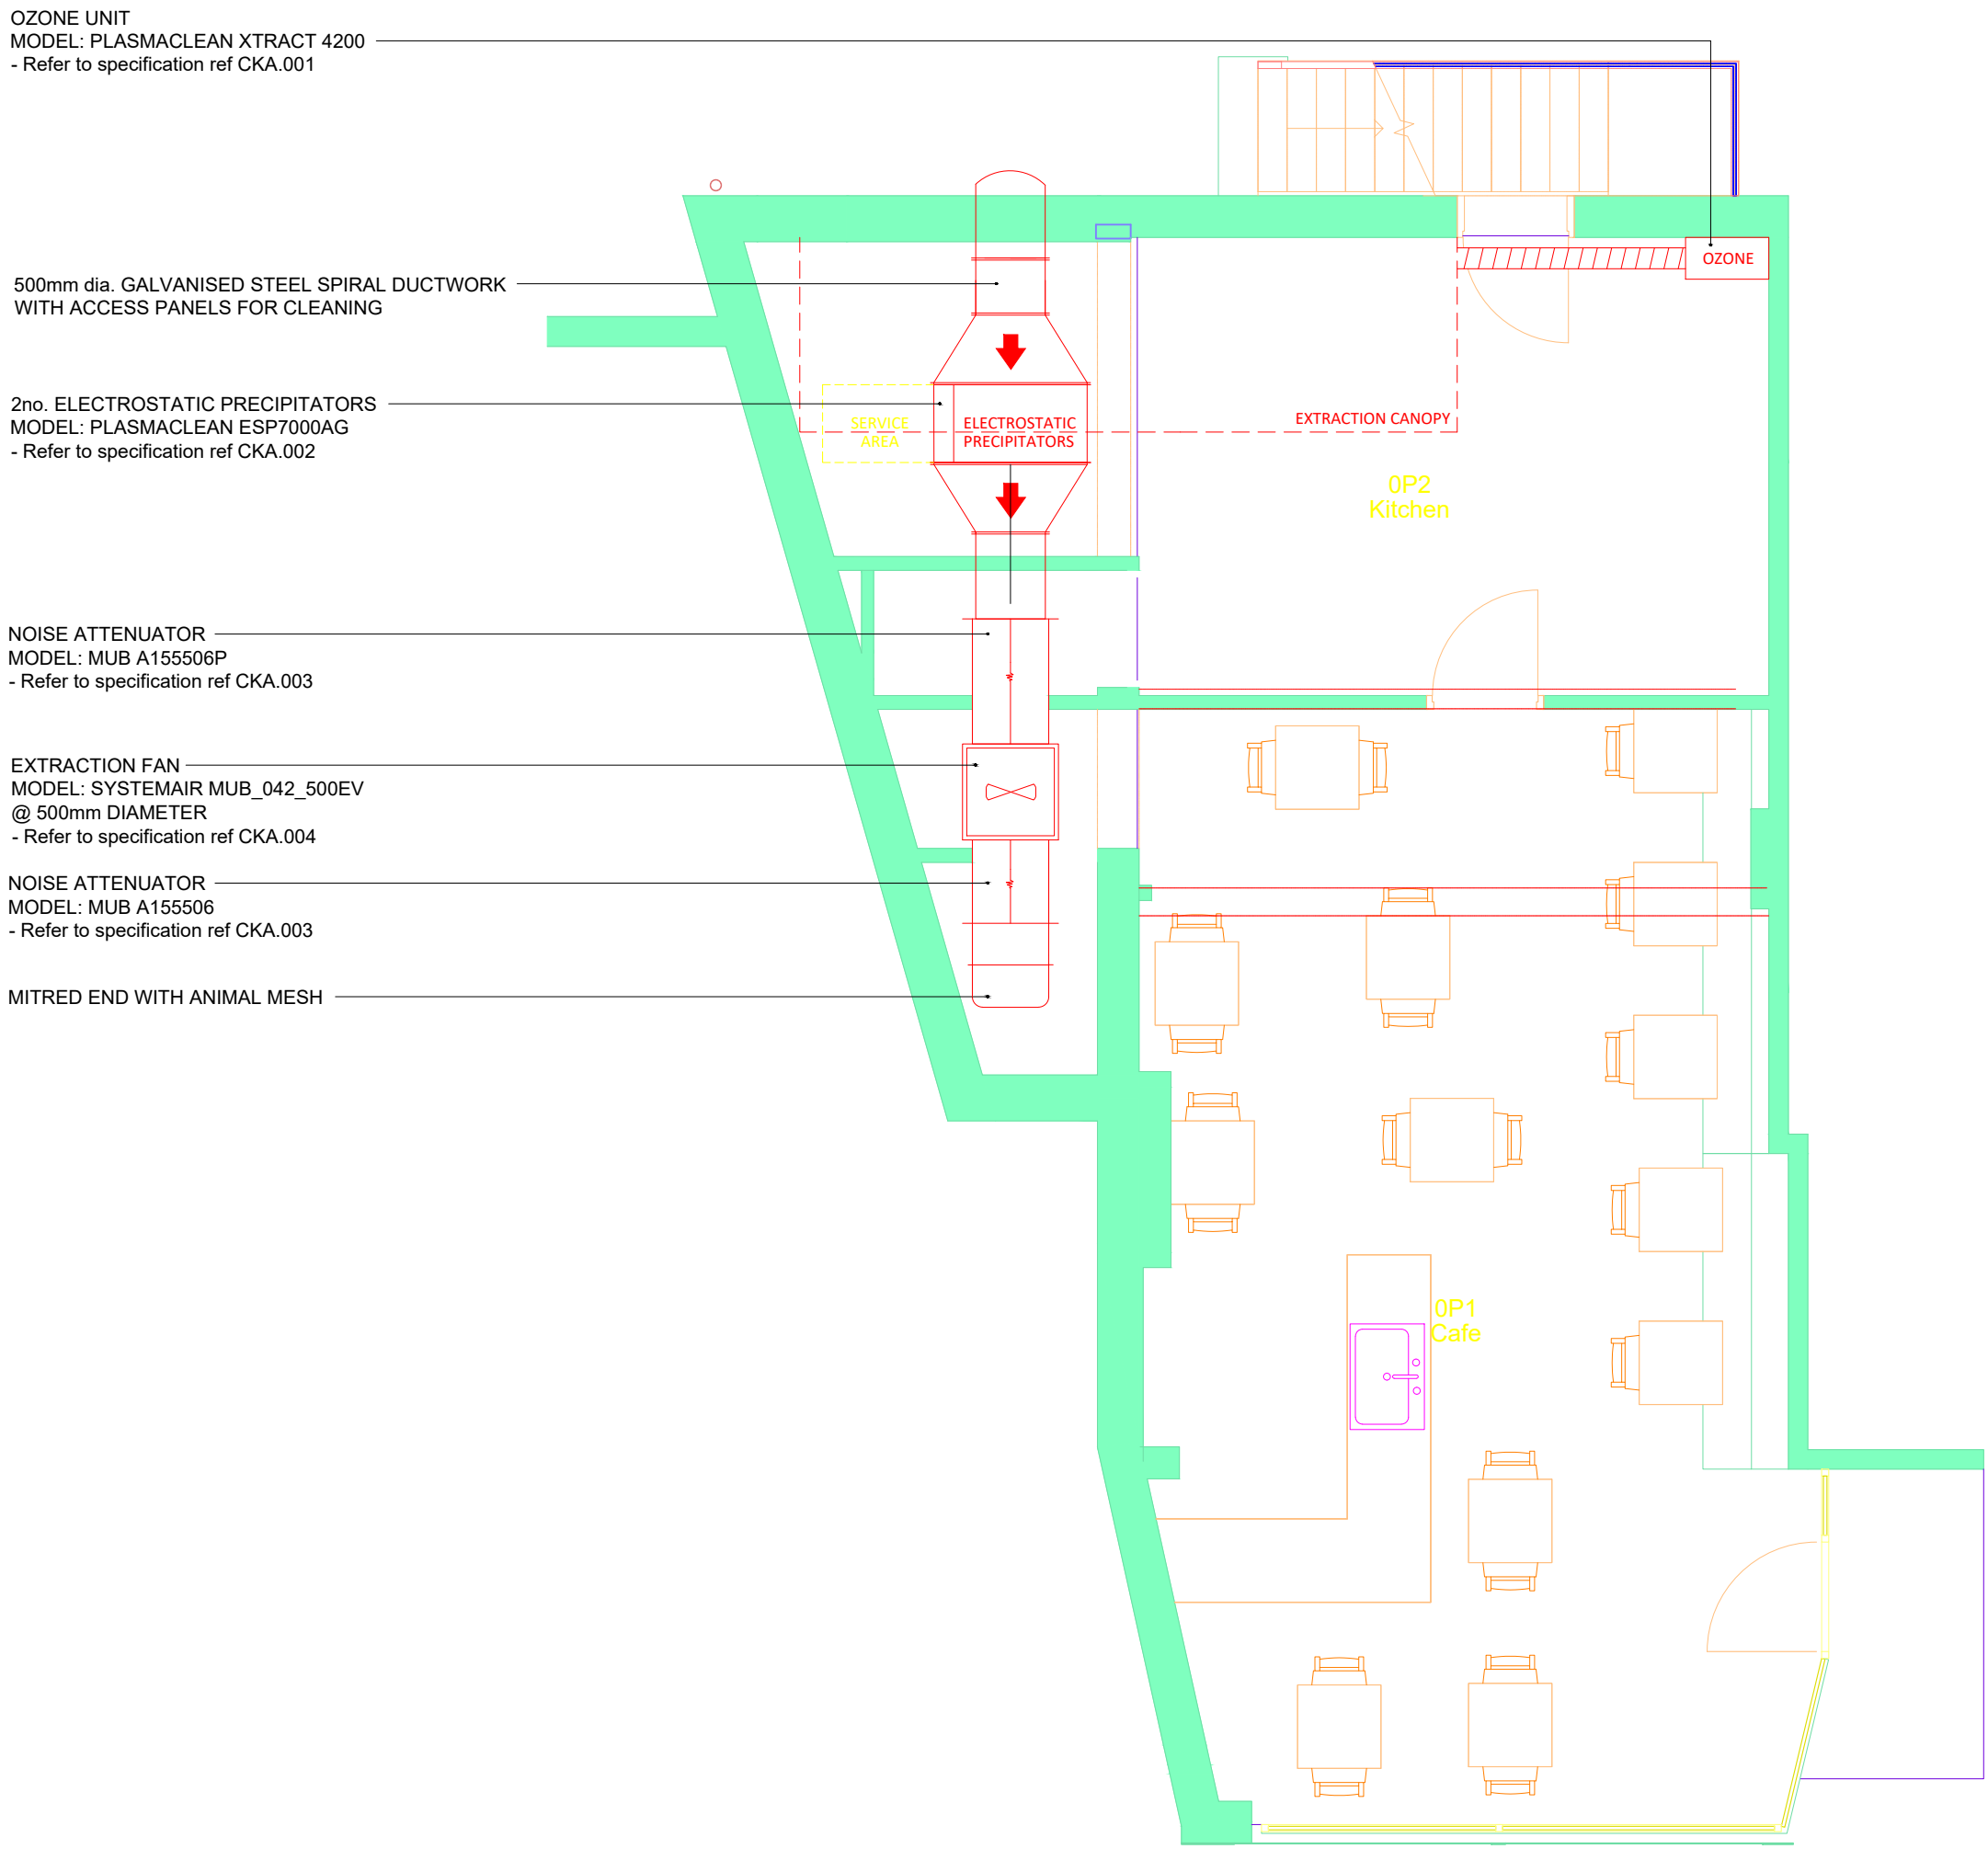

PROPOSED PLAN VIEW

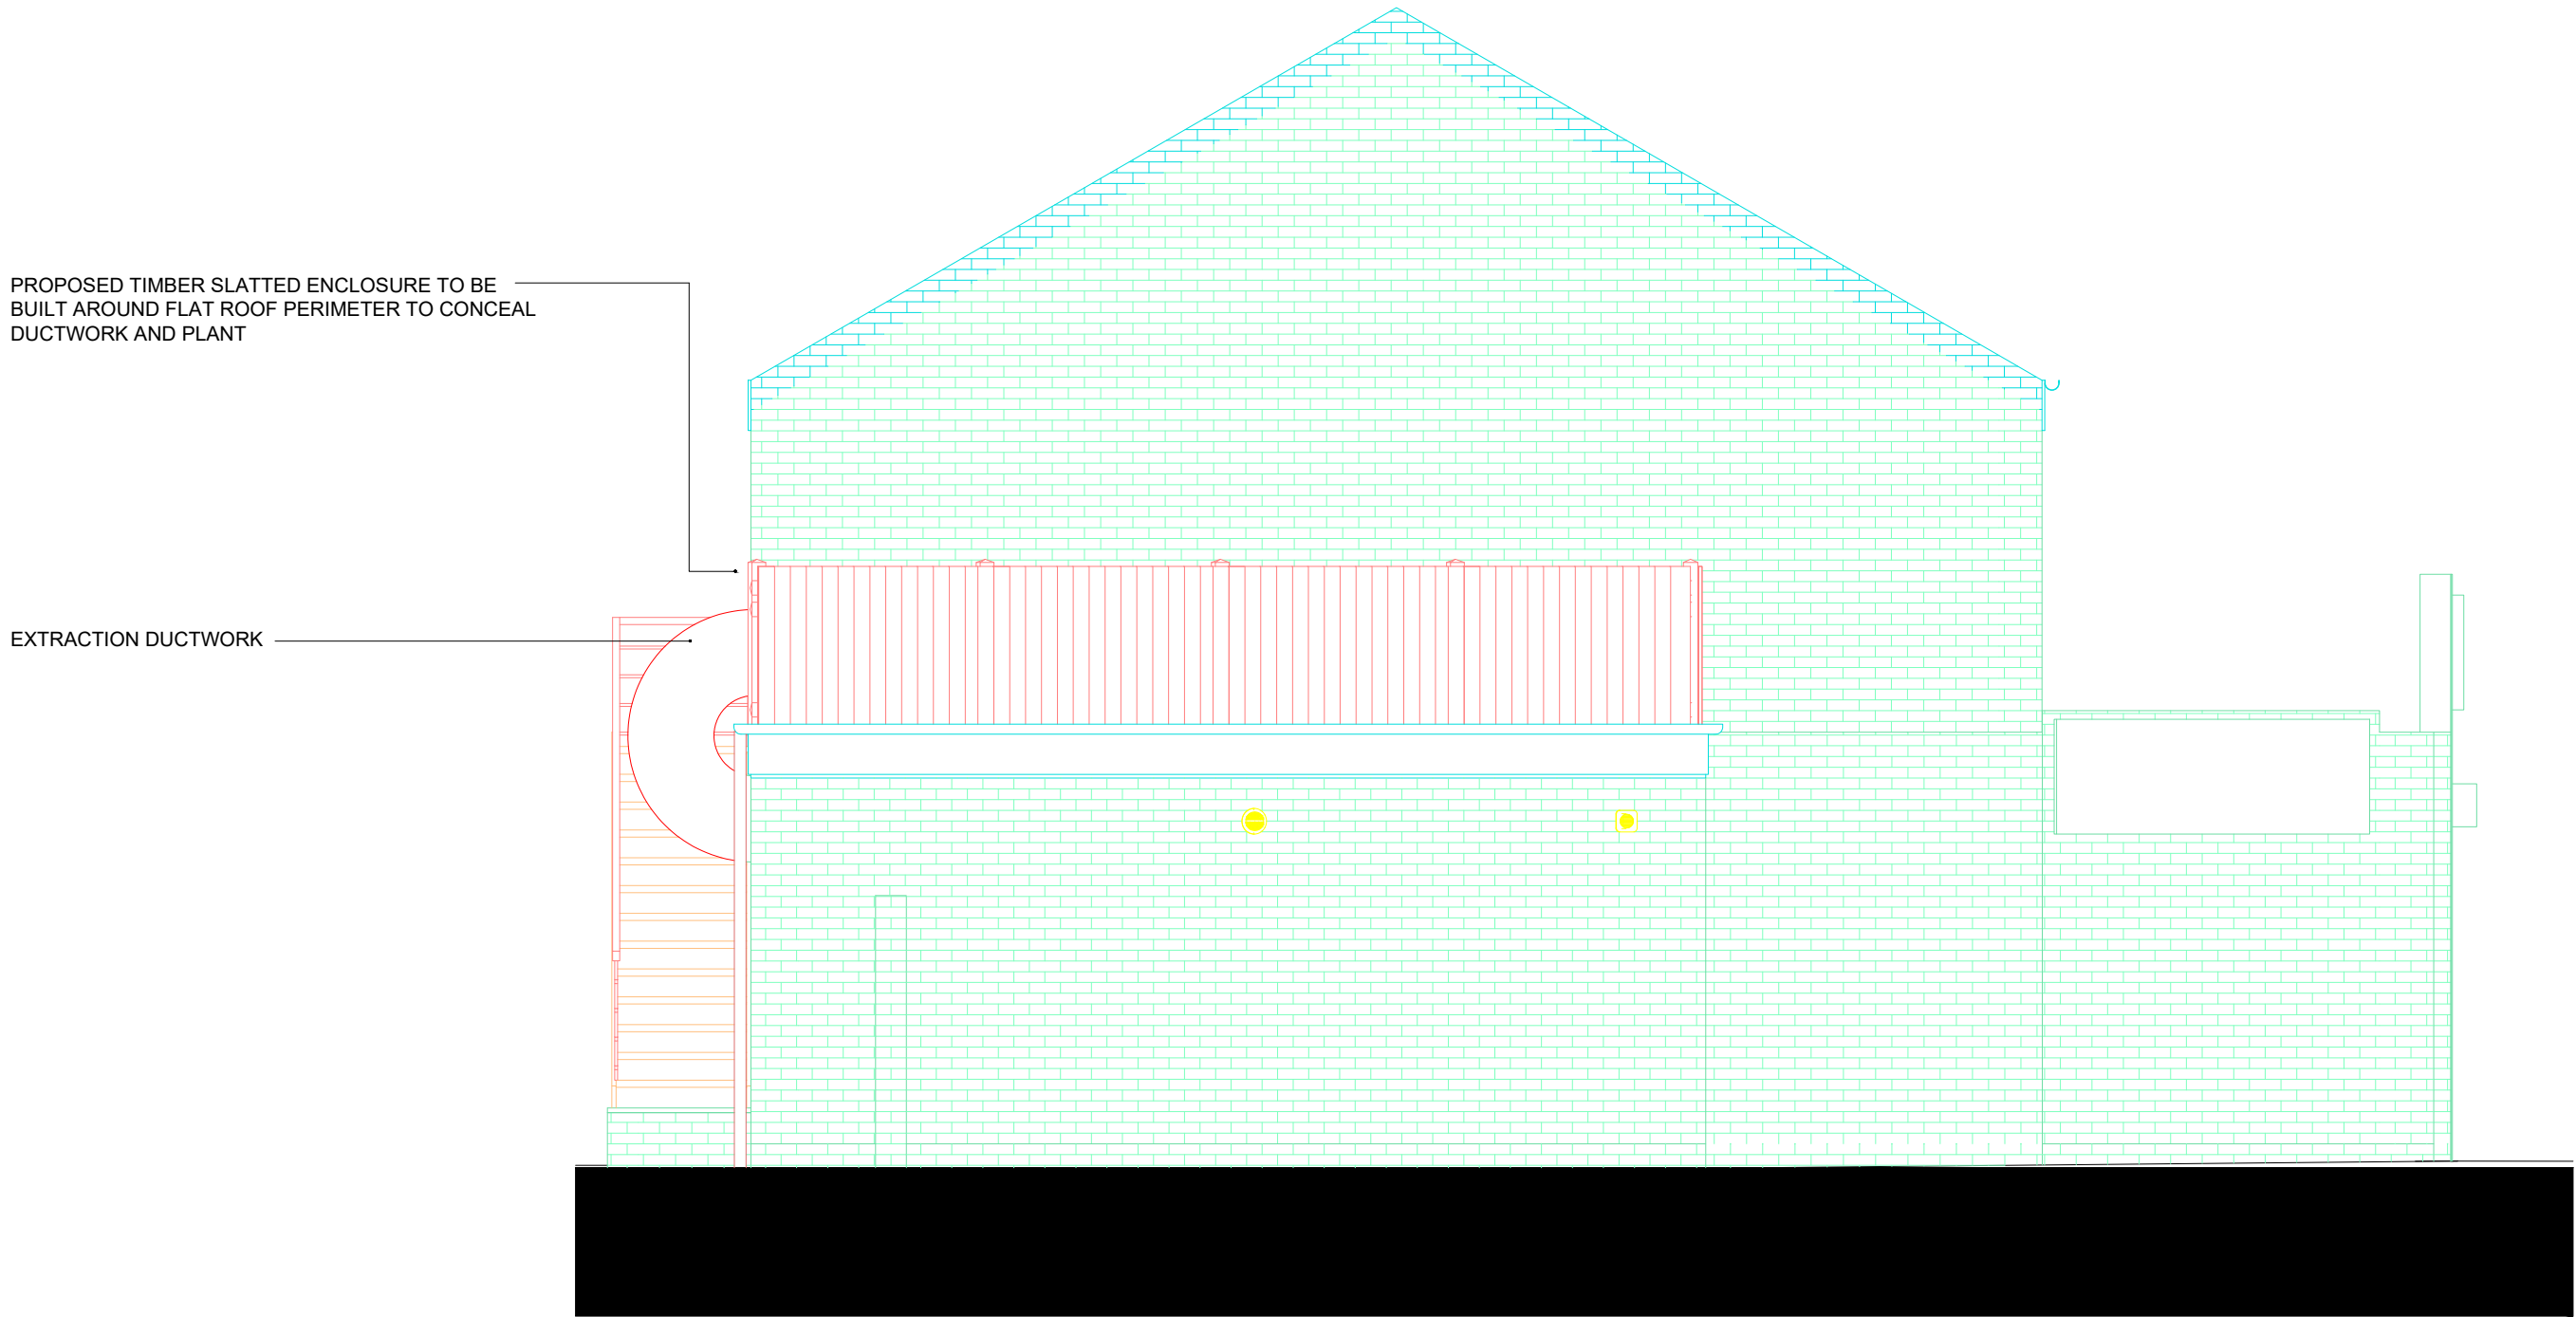

PROPOSED LEFT SIDE ELEVATION

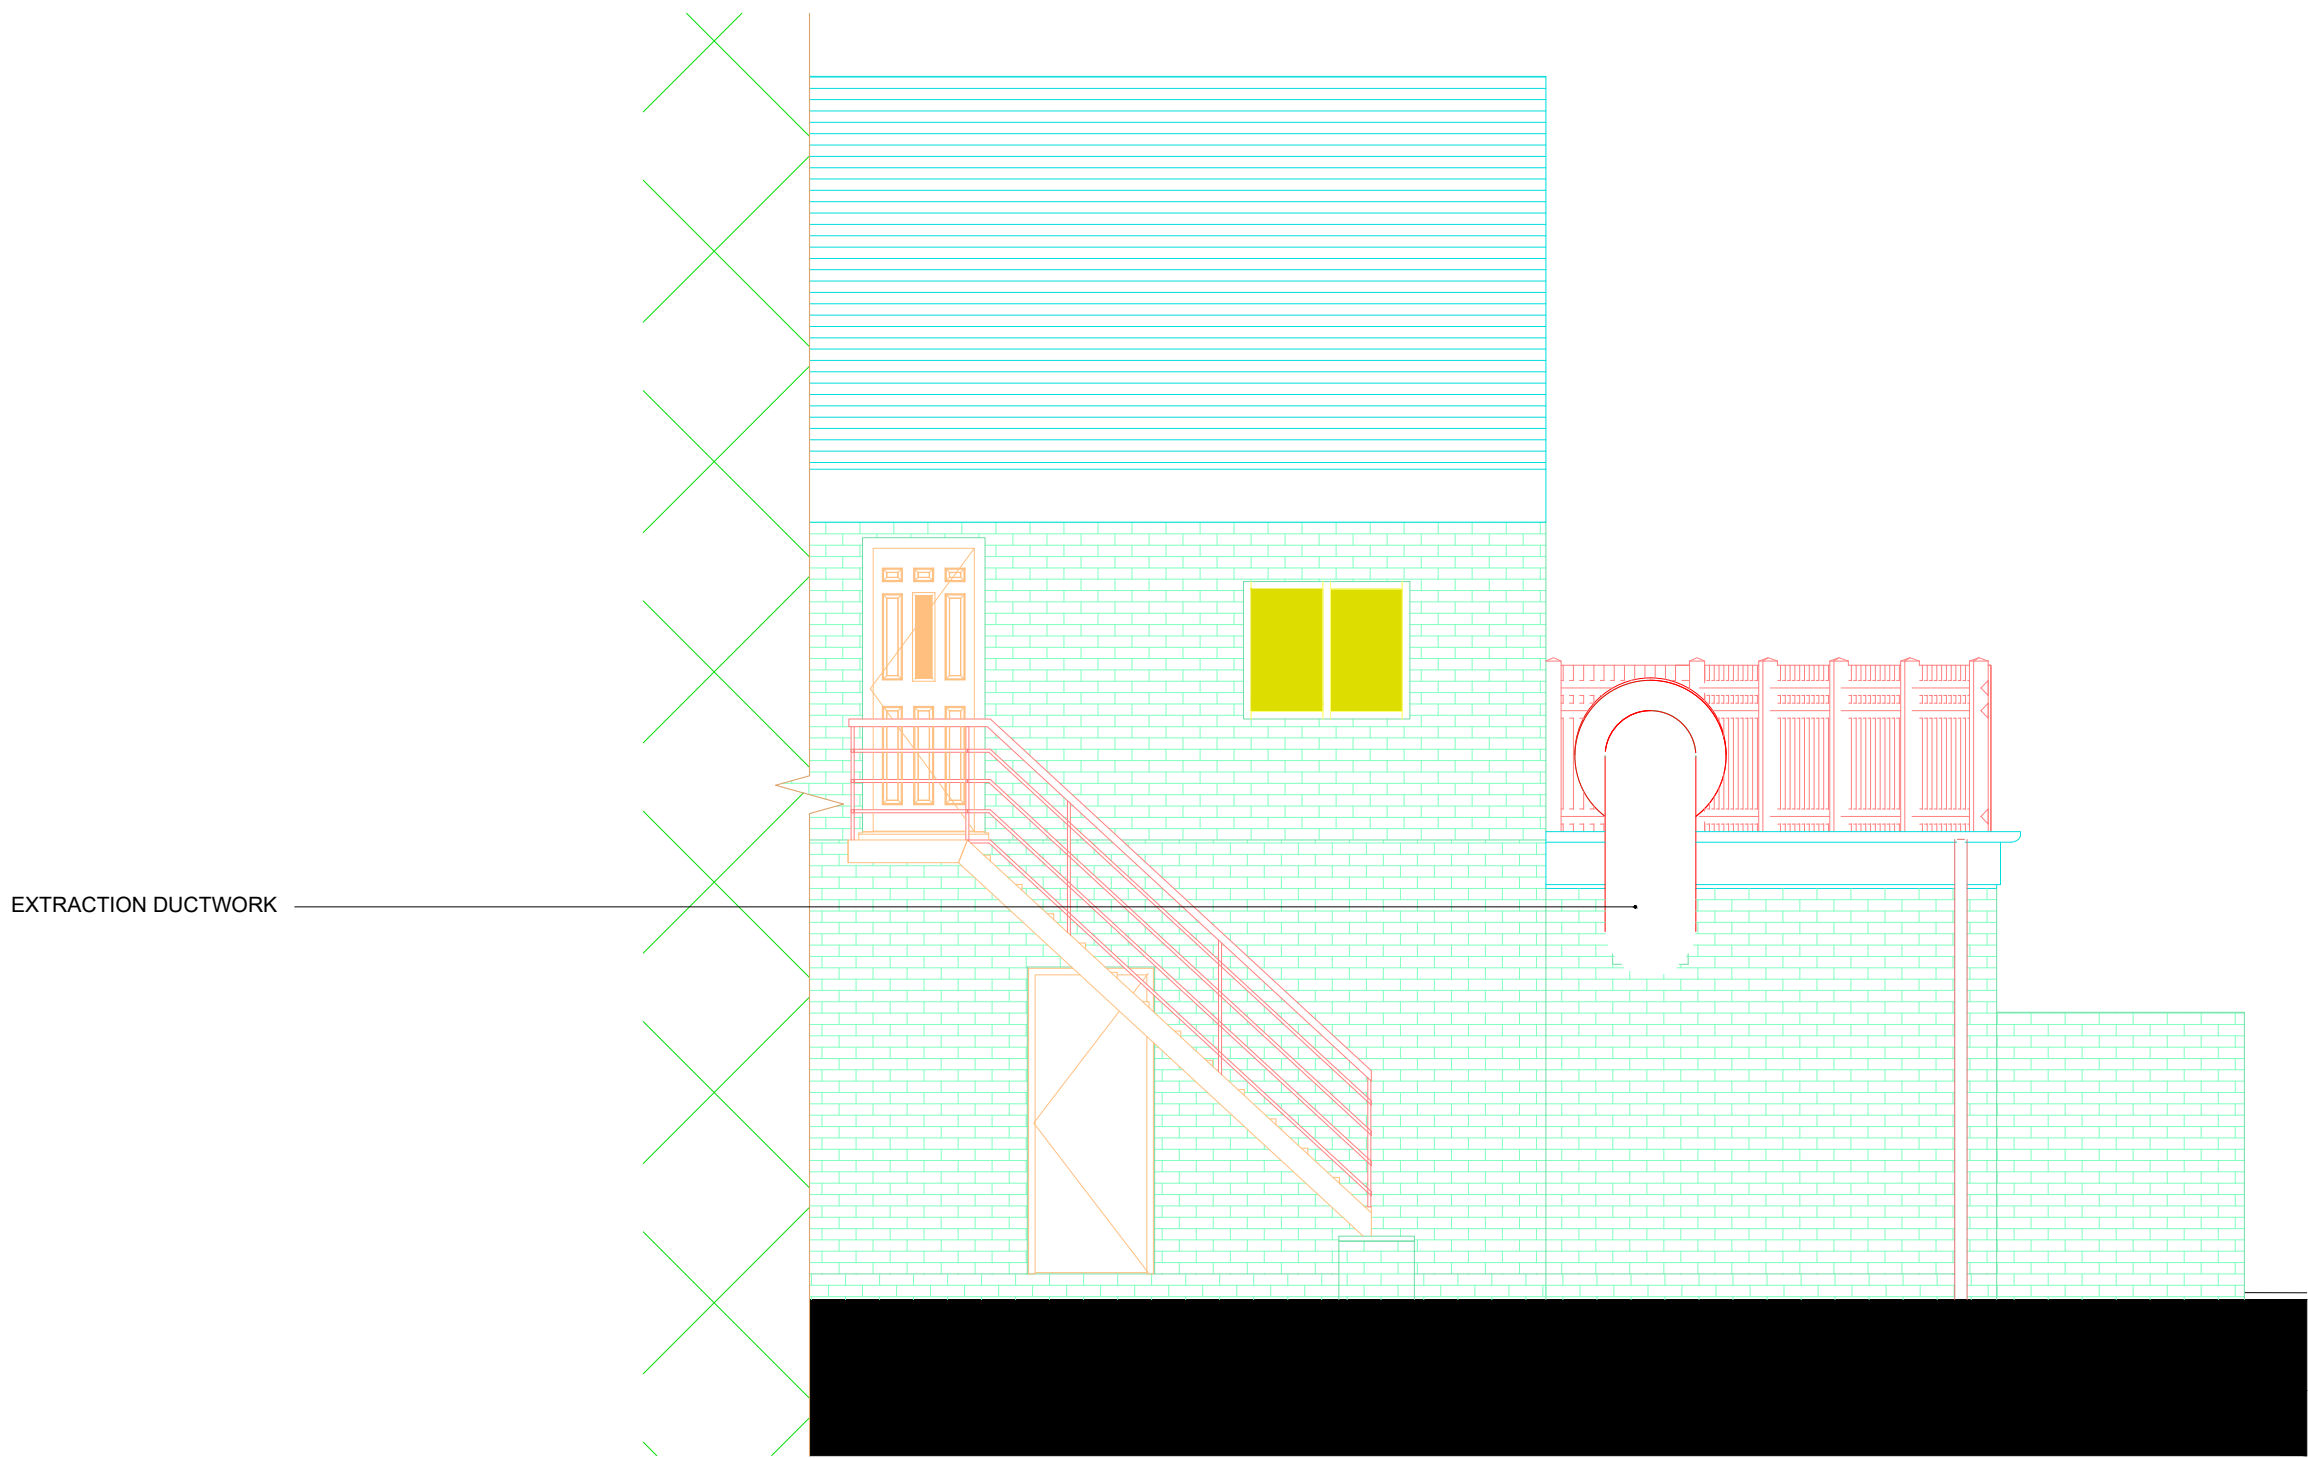

PROPOSED REAR ELEVATION

SITE MEASUREMENTS

DO NOT SCALE FROM THIS DRAWING. MEASUREMENTS ARE INDICATIVE AND SHOULD BE CHECKED ON SITE AND CONFIRMED PRIOR TO COMMENCEMENT OF ANY CONSTRUCTION WORK OR MANUFACTURING. THIS DRAWING IS COPYRIGHT OF CKA LTD AND MAY NOT BE COPIED OR REPRODUCED IN ANY FORM WITHOUT WRITTEN APPROVAL.

CKA COMMERCIAL KITCHEN ASSISTANCE LIMITED
Unit 2 Radiant Works | Burnley Road | Rossendale
Lancashire | BB4 8EW
T: 01706 260378 M: 07412 680374
E: info@ck-assistance.co.uk
www.ck-assistance.co.uk

CLIENT: SAMUEL TERRIS TAYLOR

SITE: 425 BURY NEW ROAD, PRESTWICH

DRAWN BY: NH

Scale:

Drawing No:

DATE: 02.08.2021

1:50

1188C_EX
REV. B

REV.	DATE	REVISION	BY
A	25.10.21	REVISION TO INCLUDE REAR ELEVATION	NH
B	16.05.23	REVISION TO INCLUDE ESP'S & OZONE EQUIPMENT	NH

NOISE LEVELS:

Based upon the details shown above and the technical data of each individual fan and associated silencers (if applicable), the resulting noise levels are as follows;

EXTRACT FAN
Calculated total overall A weighted sound pressure level contribution = 64.0dBA @ 3m free field

SUPPLY AIR FAN
Not required - Electric equipment only