


* NOTE O/ALL WIDTH FOR
CONTINENTAL EUROPEAN
BUILDINGS


DOOR & WINDOW POSITIONS MAY BE
DIFFERENT TO THOSE SHOWN ON
SPECIFIC CONTRACT DRAWINGS

STANDARD COLOURS


- External : Wall Cladding,
Fascia, Corner &
Bottom Wall Trims
- Door leaf
- Door Frame
Door Furniture
Windows
- Roof
Outer Legs
Inner Legs
- Soles & Scottish Divisions – Albatross nearest BS ref. 18 B 17
 - Hire & European Divisions – Goosewing Grey nearest BS ref. 10 A 05
 - Sales & Scottish Divisions – Britannia Blue nearest BS ref. 18 E 58
 - Hire – Merlin Grey nearest BS ref. 18 B 25
 - Portaloos & Events – Poppy Red nearest BS ref. 04 E 53
 - European Division – Goosewing Grey nearest BS ref. 10 A 05
 - Silver Anodised Aluminium.
 - Monhatten Grey NCS S 2502–Y RAL–DS 080 70 05.
 - Sales & Scottish Divisions – Britannia Blue nearest BS ref. 18 E 58
 - Hire – Grey nearest RAL 7042
 - Portaloos & Events – Blue Grey nearest BS ref. 18 B 29
 - European Divisions – Blue nearest RAL 5011
 - White nearest BS ref. 00 E 55
 - Grey to BS4800 ref. 10 A 05
 - Hot dipped galvanised

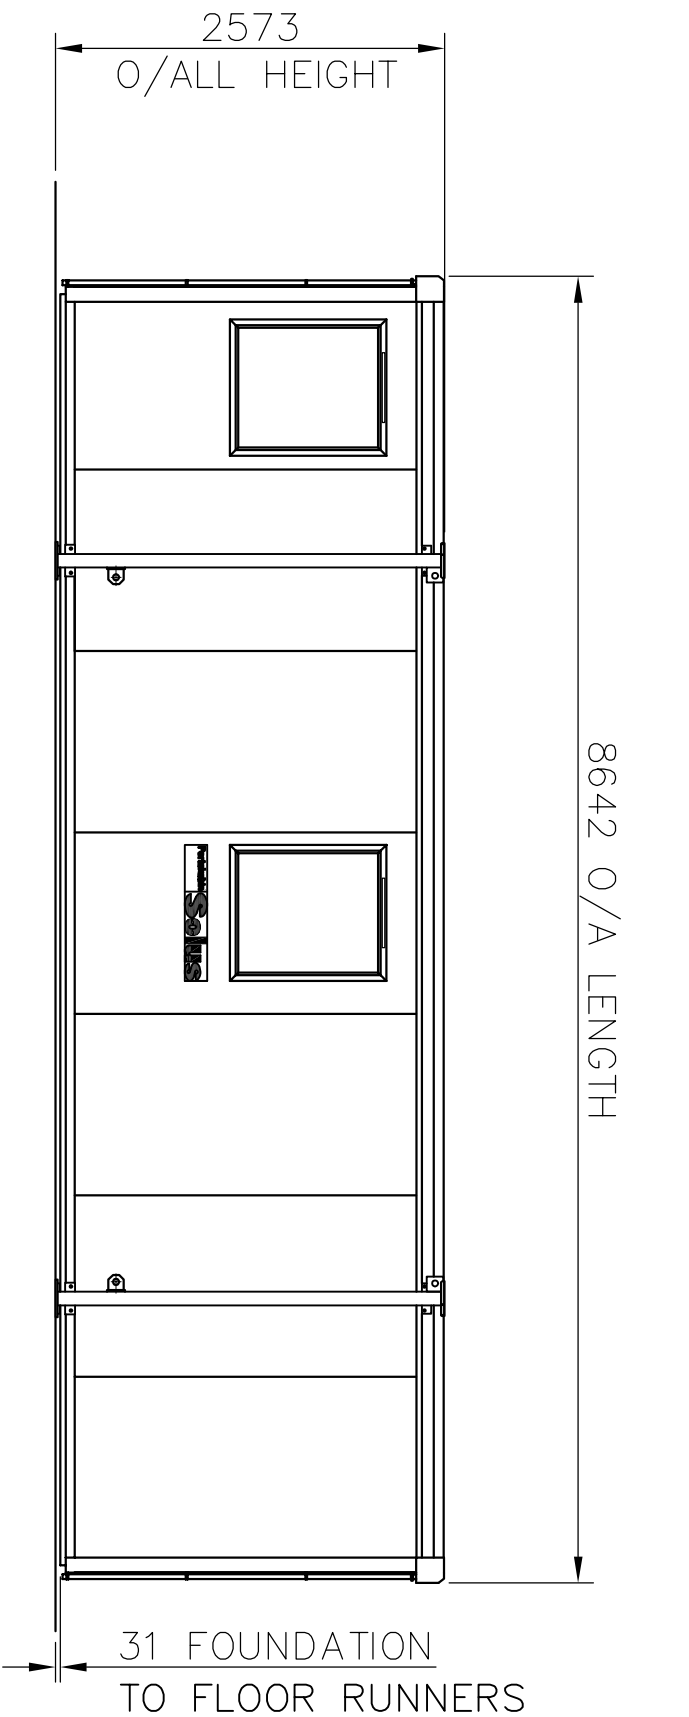


REAR ELEVATION

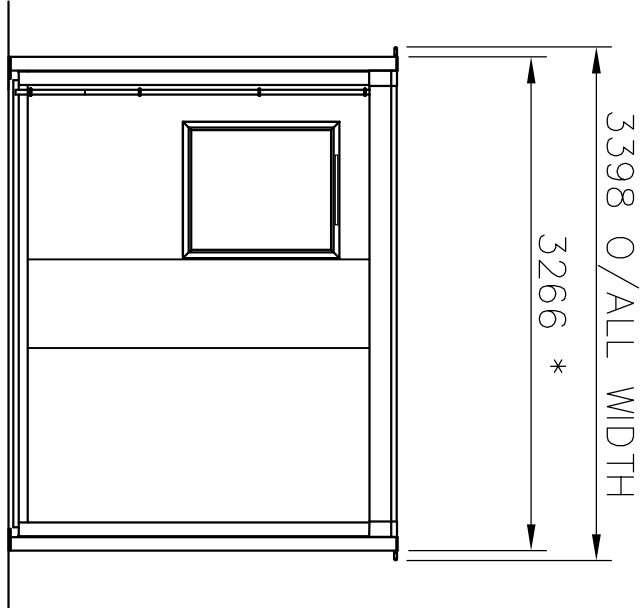

END ELEVATION

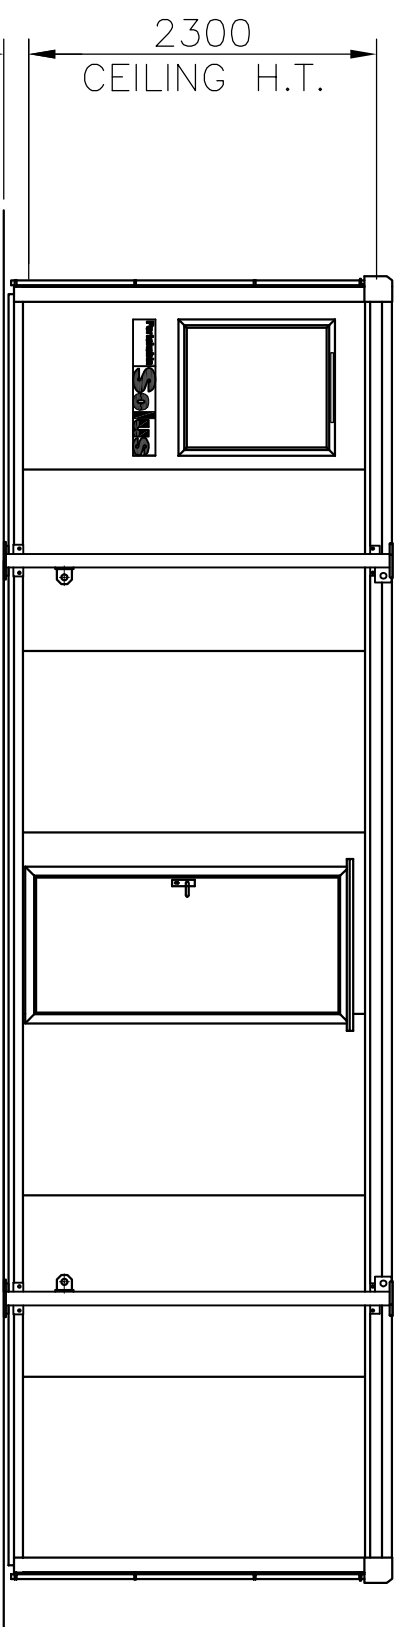


FRONT ELEVATION

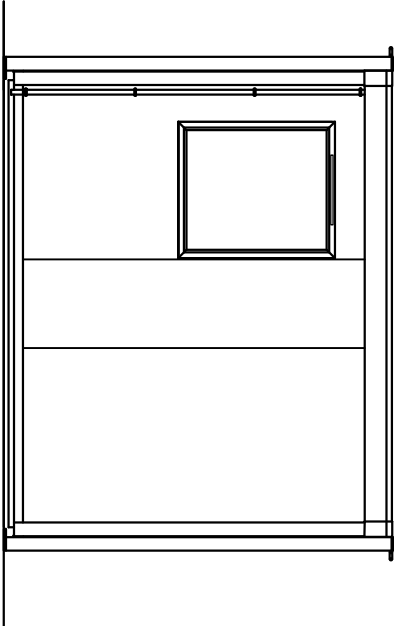

END ELEVATION


PLAN

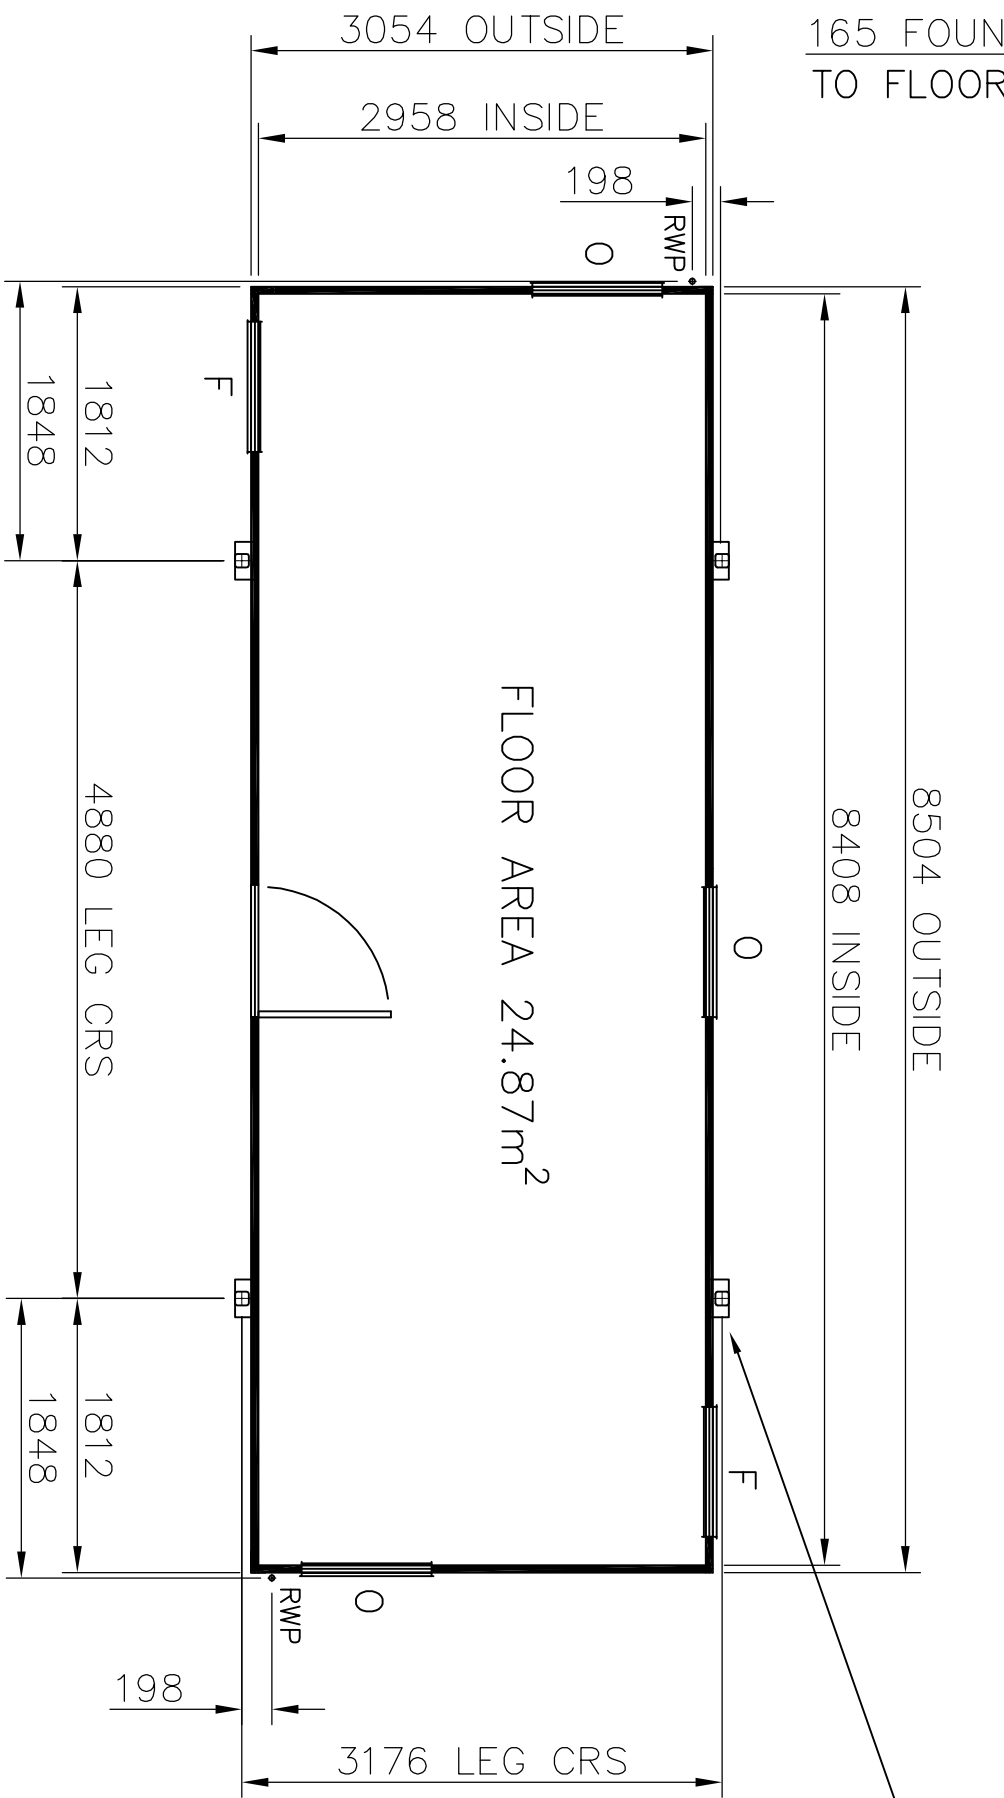

165 FOUNDATION
TO FLOOR LEVEL

8504 OUTSIDE
8408 INSIDE

LEG BASEPLATE DETAIL
PLAN VIEW

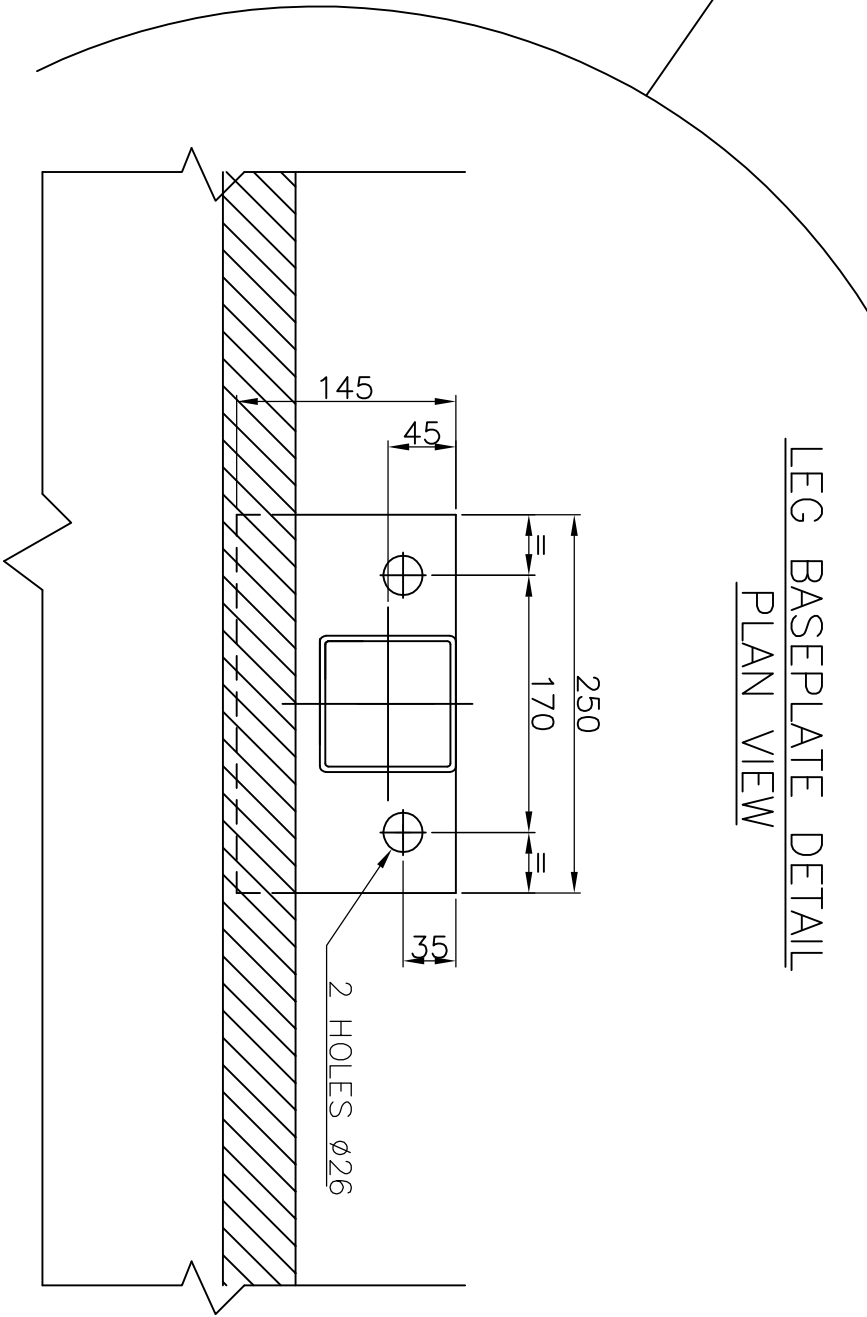

KEY

- O OPEN WINDOW
- F FIXED WINDOW
- RWP RAIN WATER PIPE

FOUNDATIONS

Simple foundations of level hardstandings are required to be capable of taking the foundation design load at each foot position of 30kN, which includes the dead weight of the building, imposed floor load of 3kN/m², imposed roof load of 0.75kN/m², and a basic wind speed to meet the requirements of BS6399: Part 2.

The foundations are to designed in accordance with BS8004 with level tops of a tolerance of ±3mm.

The area of ground under the building, plus a surrounding 500mm must be no higher than 50mm below the tops of the building foundations.

All buildings are to be anchored to the foundations via the baseplate using M20 anchor bolts, unless it can be

established that no climatic or other forces are likely to be applied so as to exceed the intrinsic stability of the building in its unloaded state.

All Lodastrut legs should be fully retracted onto the safety stops with the leg pins fitted through the outer legs and secured by the locking cotter.

It is recommended that professional advice is obtained for the design of the foundations.



Portakabin Limited
Huntington, York, YO32 9PT
Telephone 01904 611655 Fax 01904 611644

Project PORTAKABIN SOLUS

Client

Title

SPECIFICATION
DRAWING

SLO82

Lodastrut Leg Option

Date	Drawn
1.10.07	R.SCHOFIELD
Scale	1:5 & 1:50
Dwg. No.	DQ2694
Rev.	C