


THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT, THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING / INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

NOTES

1. THE CONTRACTOR SHALL ENTER VERY EARLY DISCUSSION WITH THE DNO AND FULLY CO-ORDINATE & APPLY FOR THE FOLLOWING:
- G99 PROCESS & EQUIPMENT
 - DNO UPGRADE OF SUPPLIES & FUSES
 - DNO UPGRADE OF CT METERS.
2. ALL ELECTRICAL WORK TO BE FULLY CO-ORDINATED, ALLOWANCE TO BE MADE FOR NEW INCOMING CABLES. NEW CT METERING POSITIONS. ALLOW FOR MOVING OR RE-LOCATING DISTRIBUTION EQUIPMENT TO SUIT.
3. THE EXISTING MSWB INCOMER SHALL BE REPLACED, ALL NEW CABLING INSTALLED ON CABLE TRAY.
4. ALL WORKS IN ACCORDANCE WITH BS7671 WIRING REGULATIONS.

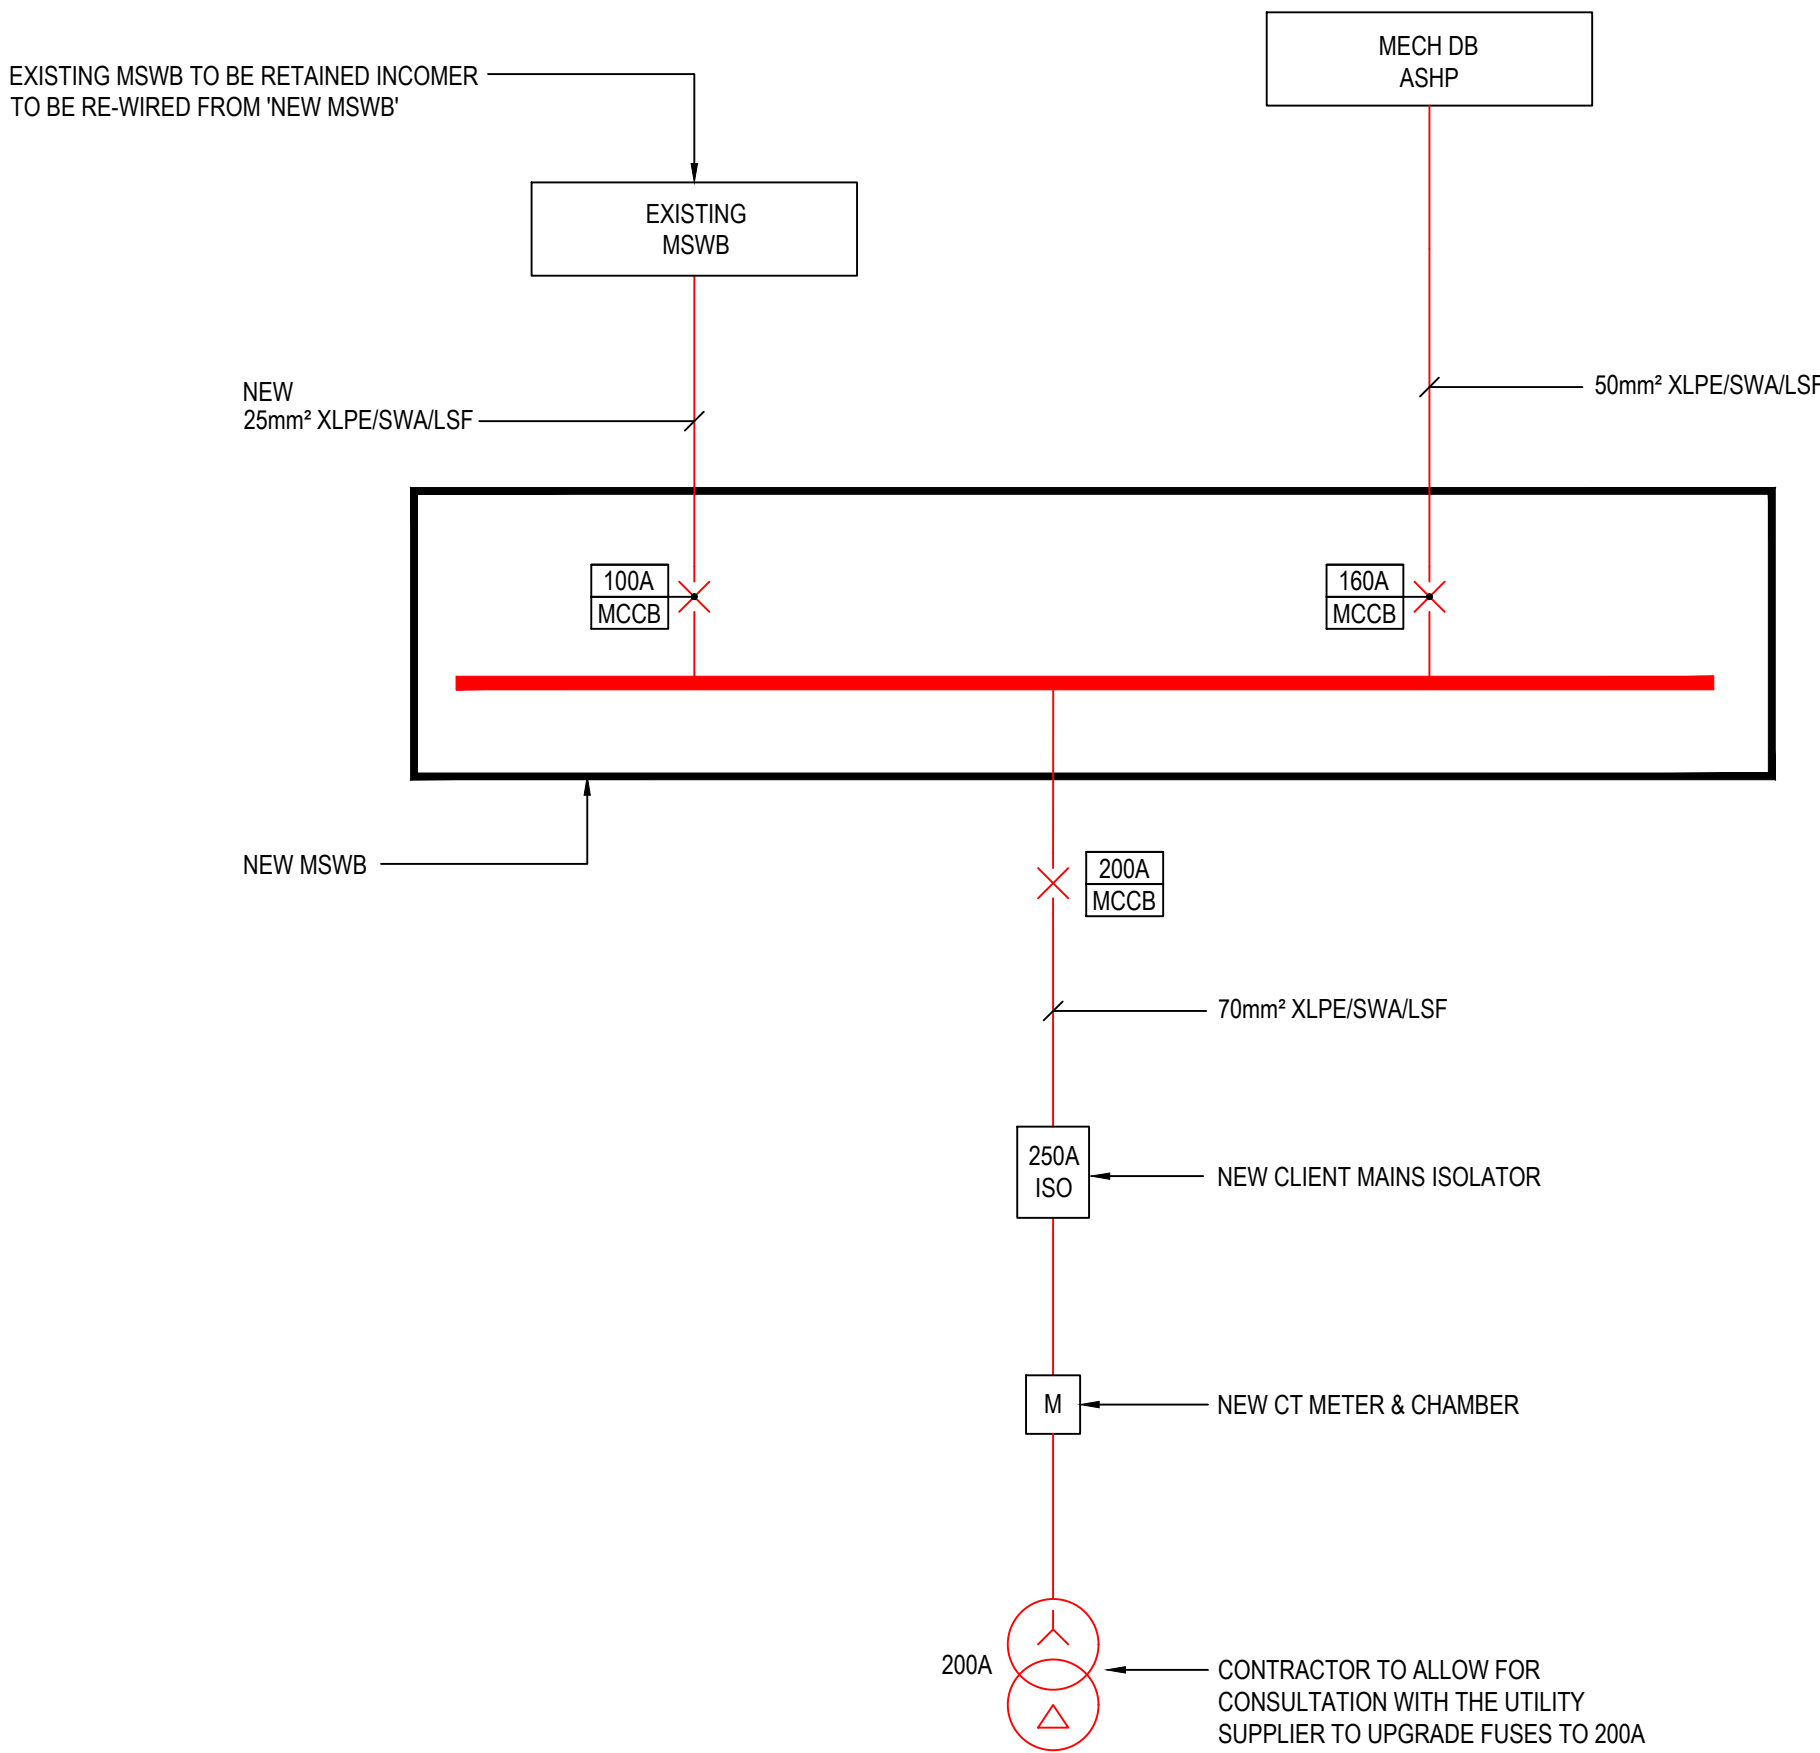

P02	REVISED SCOPE	DR	IC	IC	04/25
P01	PRELIMINARY ISSUE	JK	JK	JK	04/24
REV	DESCRIPTION	BY	CHK	APP	DATE

Project Status: **PRELIMINARY**



ENGINEERING POWERED BY THE PAST
BUILDING THE FUTURE

Core, Worklife
Brown Street
Manchester, M2 1DH
T 44 (0) 161 239 8318
www.harleyhaddow.com

Project: 312991

**GREATER MANCHESTER
FIRE AND RESCUE SERVICE
CARBON 4 PROJECTS**

Drawing Title:
**BURY COMMUNITY FIRE
STATION PROPOSED
ELECTRICAL SCHEMATIC**

Scale @ A1	Date	Engineer
NTS	APR 2024	JK
Drawing No.	Revision	
312991-HAH-BY-XX-D-E-06010	P02	