

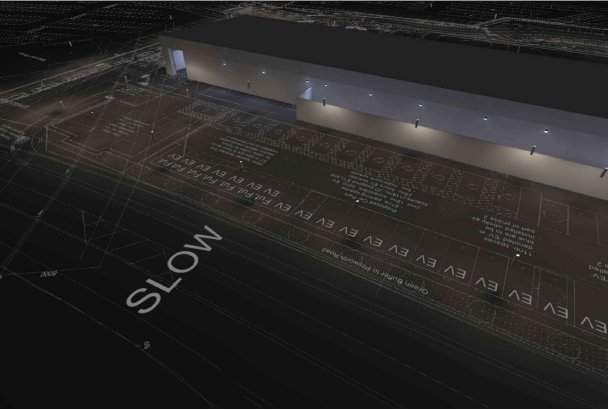
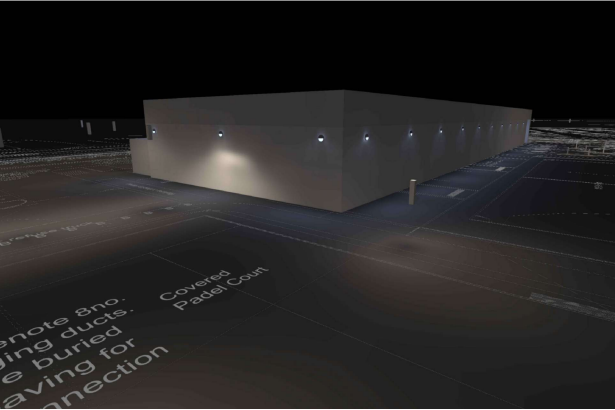
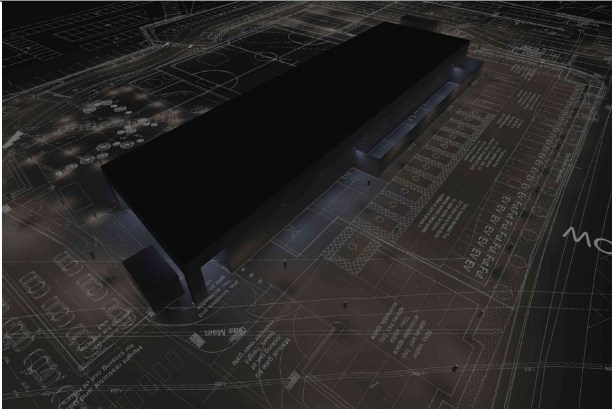
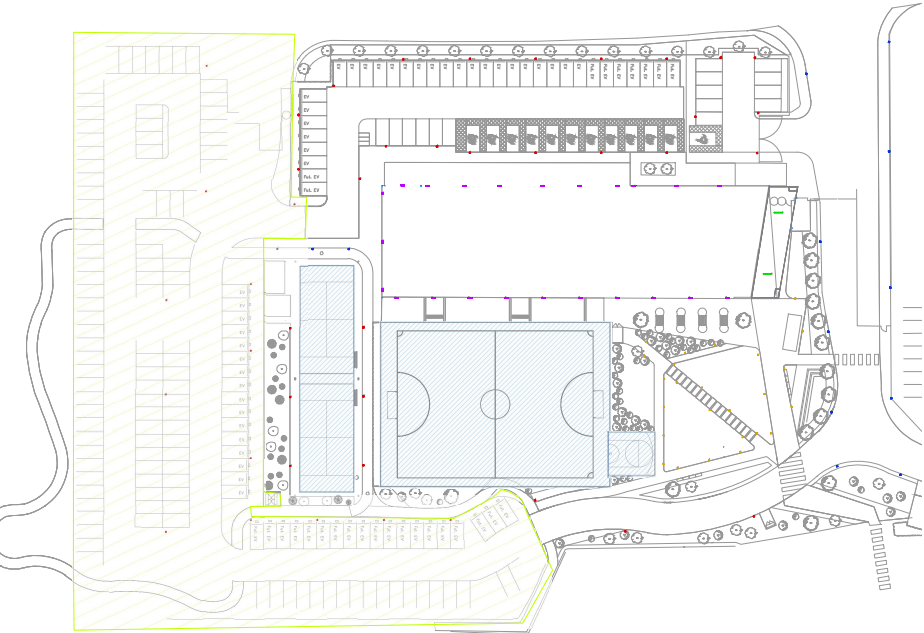
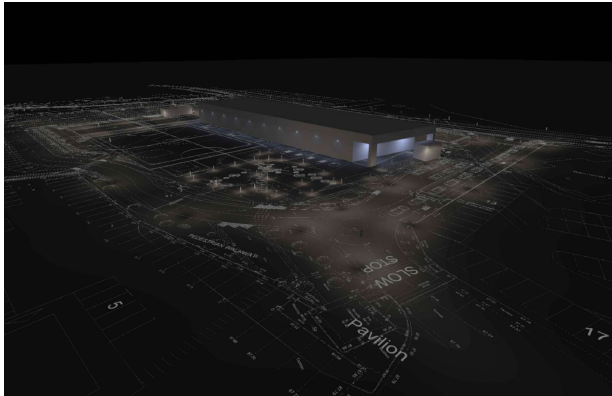


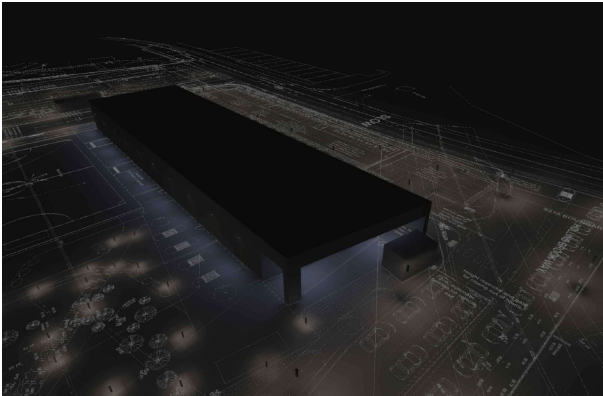

- NOTES:
1. ALL DIMENSIONS ARE IN mm.
 2. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS AND SERVICES ENGINEERS DRAWINGS AND SPECIFICATIONS.
 3. ALL DIMENSIONS TO BE CHECKED ON SITE BY THE CONTRACTOR AND ANY DISCREPANCIES BROUGHT TO THE ENGINEERS & ARCHITECTS ATTENTION IN ACCORDANCE WITH THE SPECIFICATION.
 4. ALL PROPRIETARY PRODUCTS TO BE USED STRICTLY IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATION AND DETAILS.
 5. ALL TEMPORARY WORKS ARE TO BE DESIGNED AND INSTALLED BY THE CONTRACTOR.
 6. ANY GRIDLINES, BUILDING LINES, ETC. ARE TO BE SET OUT IN ACCORDANCE WITH THE RELEVANT ARCHITECTS DRAWINGS.



Calculation Ref	Calculation Area	Area Type	Eavg (lux)	Emin (lux)	Uniformity >= (Emin/Eavg)	Measured Eavg (lux)	Measured Emin (lux)	Measured Uniformity	Pass/Fail
CG1	Car_Park_Staff_Pavillion	A5	10.00	2.50	0.25	14.80	8.78	0.59	PASS
CG2	Car_Park_Visitors	A5	10.00	2.50	0.25	18.30	10.80	0.59	PASS
CG18	Cycle_Shelter_UnCovered	A4	20.00	5.00	0.25	26.40	12.20	0.46	PASS
CG23	Footpath_Hollins_Brook_Way	A1	5.00	1.25	0.25	10.10	2.71	0.27	PASS
CG19	Loading_Bay	A3	50.00	20.00	0.40	53.90	21.58	0.40	PASS
CG11	Refuse_Store_Ext	A7	10.00	2.50	0.25	18.00	7.07	0.39	PASS
CG16	Roadway_A	A2	10.00	4.00	0.40	11.50	5.17	0.45	PASS
CG14	Roadway_B	A2	10.00	4.00	0.40	16.40	6.57	0.40	PASS
CG13	Pedestrian_Walkway_A	A1	5.00	1.25	0.25	10.50	5.18	0.49	PASS
CG9	Pedestrian_Walkway_B	A1	5.00	1.25	0.25	19.70	6.68	0.34	PASS
CG10	Pedestrian_Walkway_C	A1	5.00	1.25	0.25	21.70	5.56	0.26	PASS
CG16	Pedestrian_Walkway_D	A1	5.00	1.25	0.25	29.10	10.70	0.37	PASS
CG8	Pedestrian_Walkway_E	A1	5.00	1.25	0.25	11.10	2.81	0.25	PASS
CG5	Pedestrian_Walkway_F	A1	5.00	1.25	0.25	8.28	2.34	0.28	PASS
CG7	Pedestrian_Walkway_G	A1	5.00	1.25	0.25	9.83	3.29	0.33	PASS
CG17	Pedestrian_Walkway_H	A1	5.00	1.25	0.25	25.20	12.40	0.49	PASS
CG6	Pedestrian_Walkway_I	A1	5.00	1.25	0.25	12.90	3.93	0.30	PASS
CG4	Pedestrian_Walkway_K	A1	5.00	1.25	0.25	13.20	3.55	0.27	PASS
CG3	Pedestrian_Walkway_L	A1	5.00	1.25	0.25	16.60	4.24	0.26	PASS
CG12	Plant_Enclosure_Ext	A6	20.00	5.00	0.25	20.10	6.47	0.32	PASS
CG22	Pedestrian_Walkway_M	A1	5.00	1.25	0.25	20.20	5.13	0.25	PASS
CG21	Pedestrian_Walkway_N	A1	5.00	1.25	0.25	12.70	9.17	0.72	PASS
CG20	Pedestrian_Walkway_P	A1	5.00	1.25	0.25	19.40	5.06	0.26	PASS

P02	17.12.25	PLANNING SUBMISSION	ICR	DH
P01	08.12.25	STAGE 3 ISSUE	ICR	DH
REV	DATE	DESCRIPTION	CHK	APP
© This drawing is the property of Kennedy Redford Limited and the information can only be reproduced with their prior permission.				
				
CLIENT				
JD SPORTS PLC				
PROJECT NAME				
JD SPORTS CAMPUS				
DRAWING TITLE				
EXTERNAL LIGHTING CALCULATIONS LAYOUT				
DATE	SCALE	SIZE	DRAWN BY	REV
14.10.25	NTS	A1	DHO	P02
DESIGN STAGE				
STAGE 3				
SUSTAINABILITY CODE				
S4 - ISSUED FOR STAGE APPROVAL				
DRAWING NUMBER				
250715 - KR-D - ZZ - XX - DR - E - 6331				