Luminaire list (Site 1)

Index	Manufacturer	Article name	Item number	Fitting	Luminous flux	Maintenance factor	Connected load	Quantity
1	Schréder	SHUFFLE POST TOP 5119 [Lum. shape-related, PC, Sanded], [PMMA Smooth Flat Cylindrical] Sanded diffuser 16 LH351C LED@500mA Driver@500mA WW 830 230V 01-37-043 494462	494462	1x 16 LH351C@500mA WW 830 230V 01-37-043	3762 lm	0.80	26 W	42
2	Whitecroft Lighting	KOLO IP65 HOOD	K6H44KHB	1x K6H44KHB	1008 lm	0.80	14.2 W	23
3	Thorlux Lighting	Kanby EVO - 22W - Opal - SMARTSCAN - 4000K	KE18948	1x Kanby EVO - 22W - Opal	3330 lm	0.80	25 W	2
4	Schréder	CITRINE MIDI 2289 Cylindrical, PC, Opal Symmetrical 20 NF2L757GRT (mid power)@250mA WW 830 230V 389162	389162	1x 20 NF2L757GRT (mid power)@250mA WW 830 230V	1120 lm	0.80	9 W	25
5	Schréder	SHUFFLE 360 LGT GEN2 5098 PMMA Smooth Flat Cylindrical 16 XP-G3@700mA WW 830 230V 01-37-043 492602	492602	1x 16 XP-G3@700mA WW 830 230V 01-37-043	5126 lm	0.80	36.5 W	13

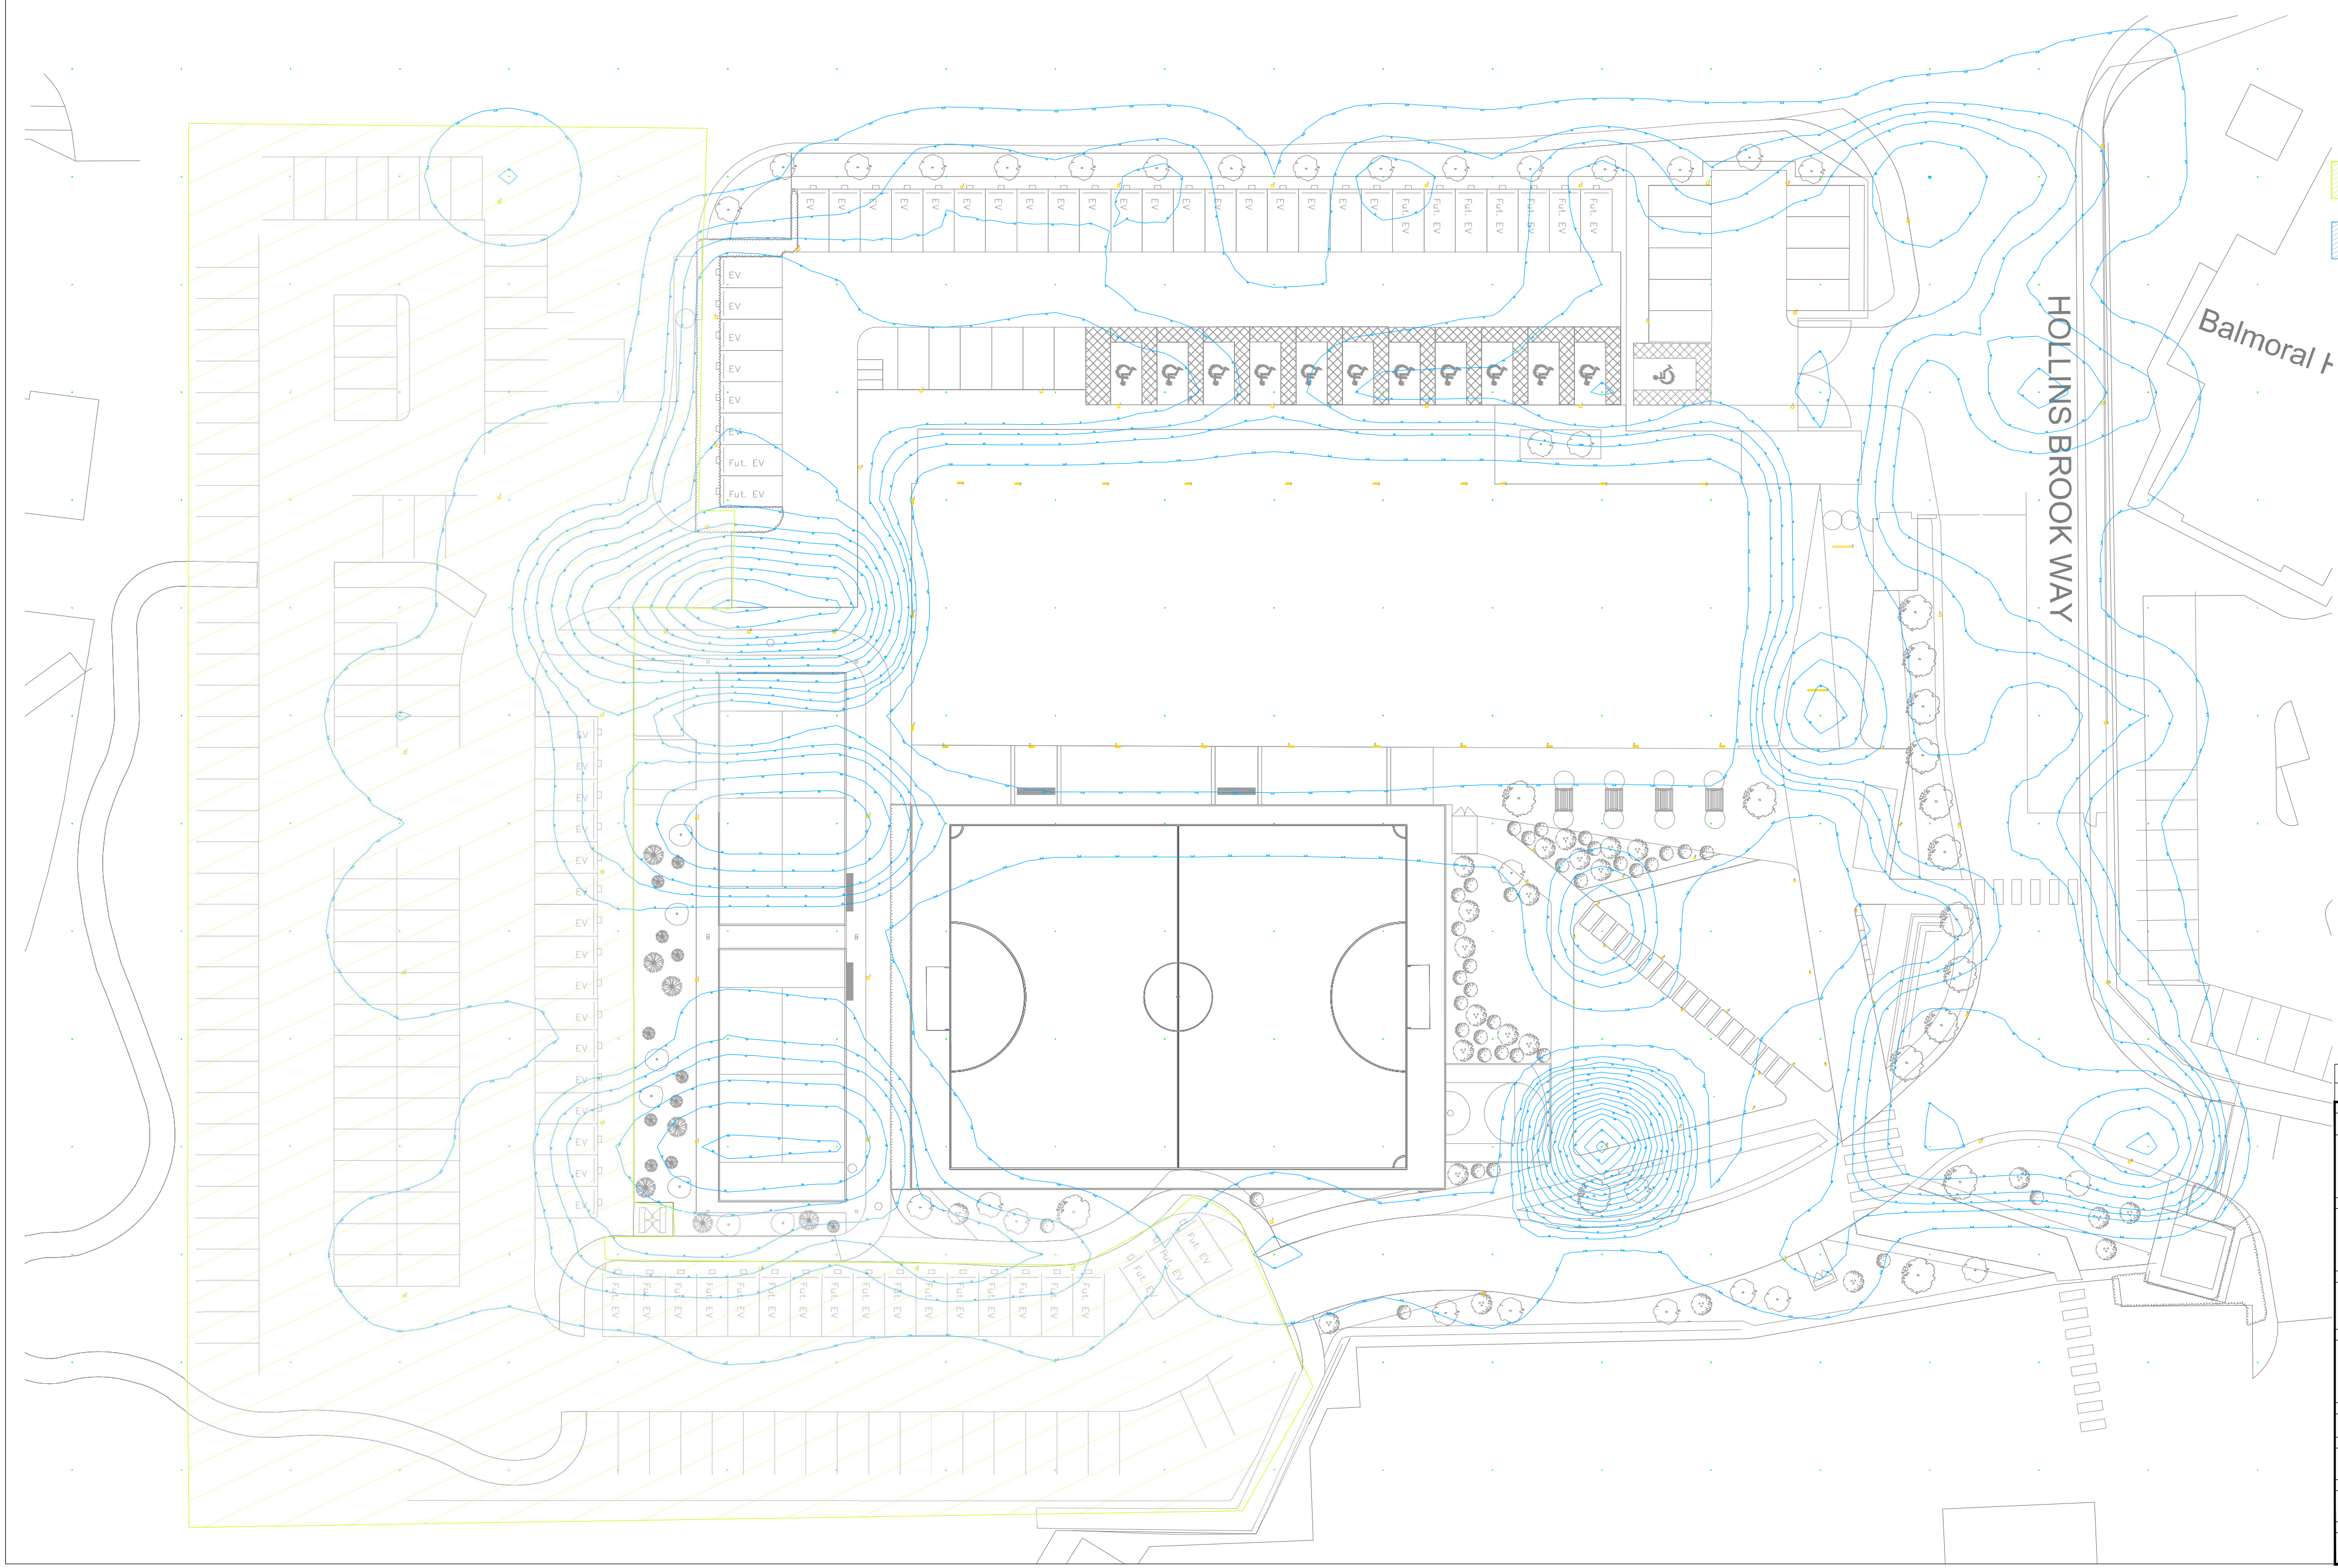

NOTES:

1. ALL DIMENSIONS ARE IN mm.
2. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTS AND SERVICES ENGINEERS DRAWINGS AND SPECIFICATIONS.
3. ALL DIMENSIONS TO BE CHECKED ON SITE BY THE CONTRACTOR AND ANY DISCREPANCIES BROUGHT TO THE ENGINEERS & ARCHITECTS ATTENTION IN ACCORDANCE WITH THE SPECIFICATION.
4. ALL PROPRIETARY PRODUCTS TO BE USED STRICTLY IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATION AND DETAILS.
5. ALL TEMPORARY WORKS ARE TO BE DESIGNED AND INSTALLED BY THE CONTRACTOR.
6. ANY GRIDLINES, BUILDING LINES, ETC. ARE TO BE SET OUT IN ACCORDANCE WITH THE RELEVANT ARCHITECTS DRAWINGS.

LEGEND

🟩	REFER TO PHASE 1 AS BUILT LIGHTING LAYOUTS & CALCULATIONS FOR FURTHER DETAILS
🟦	LIGHTING LAYOUTS & CALCULATIONS BY SPECIALIST MUGA & PADEL COURT SUPPLIES

REV	DATE	DESCRIPTION	CHK	APR
P02	17.12.25	PLANNING SUBMISSION	ICR	DHI
P01	08.12.25	STAGE 3 ISSUE	ICR	DHI

© This drawing is the property of Kennedy Redford Limited and the information can only be reproduced with their prior permission.

Kennedy Redford
MANAGING VISION

CLIENT
JD SPORTS PLC

PROJECT NAME
JD SPORTS CAMPUS

DRAWING TITLE
EXTERNAL LIGHTING
ISOLINE LAYOUT

DATE	SCALE	SIZE	DRAWN BY	REV
14.10.25	NTS	A1	DHO	P01

DESIGN STAGE
STAGE 3

SUITABILITY CODE
S4 - ISSUED FOR STAGE APPROVAL

DRAWING NUMBER
250715 - KRD - ZZ - XX - DR - E - 6332